


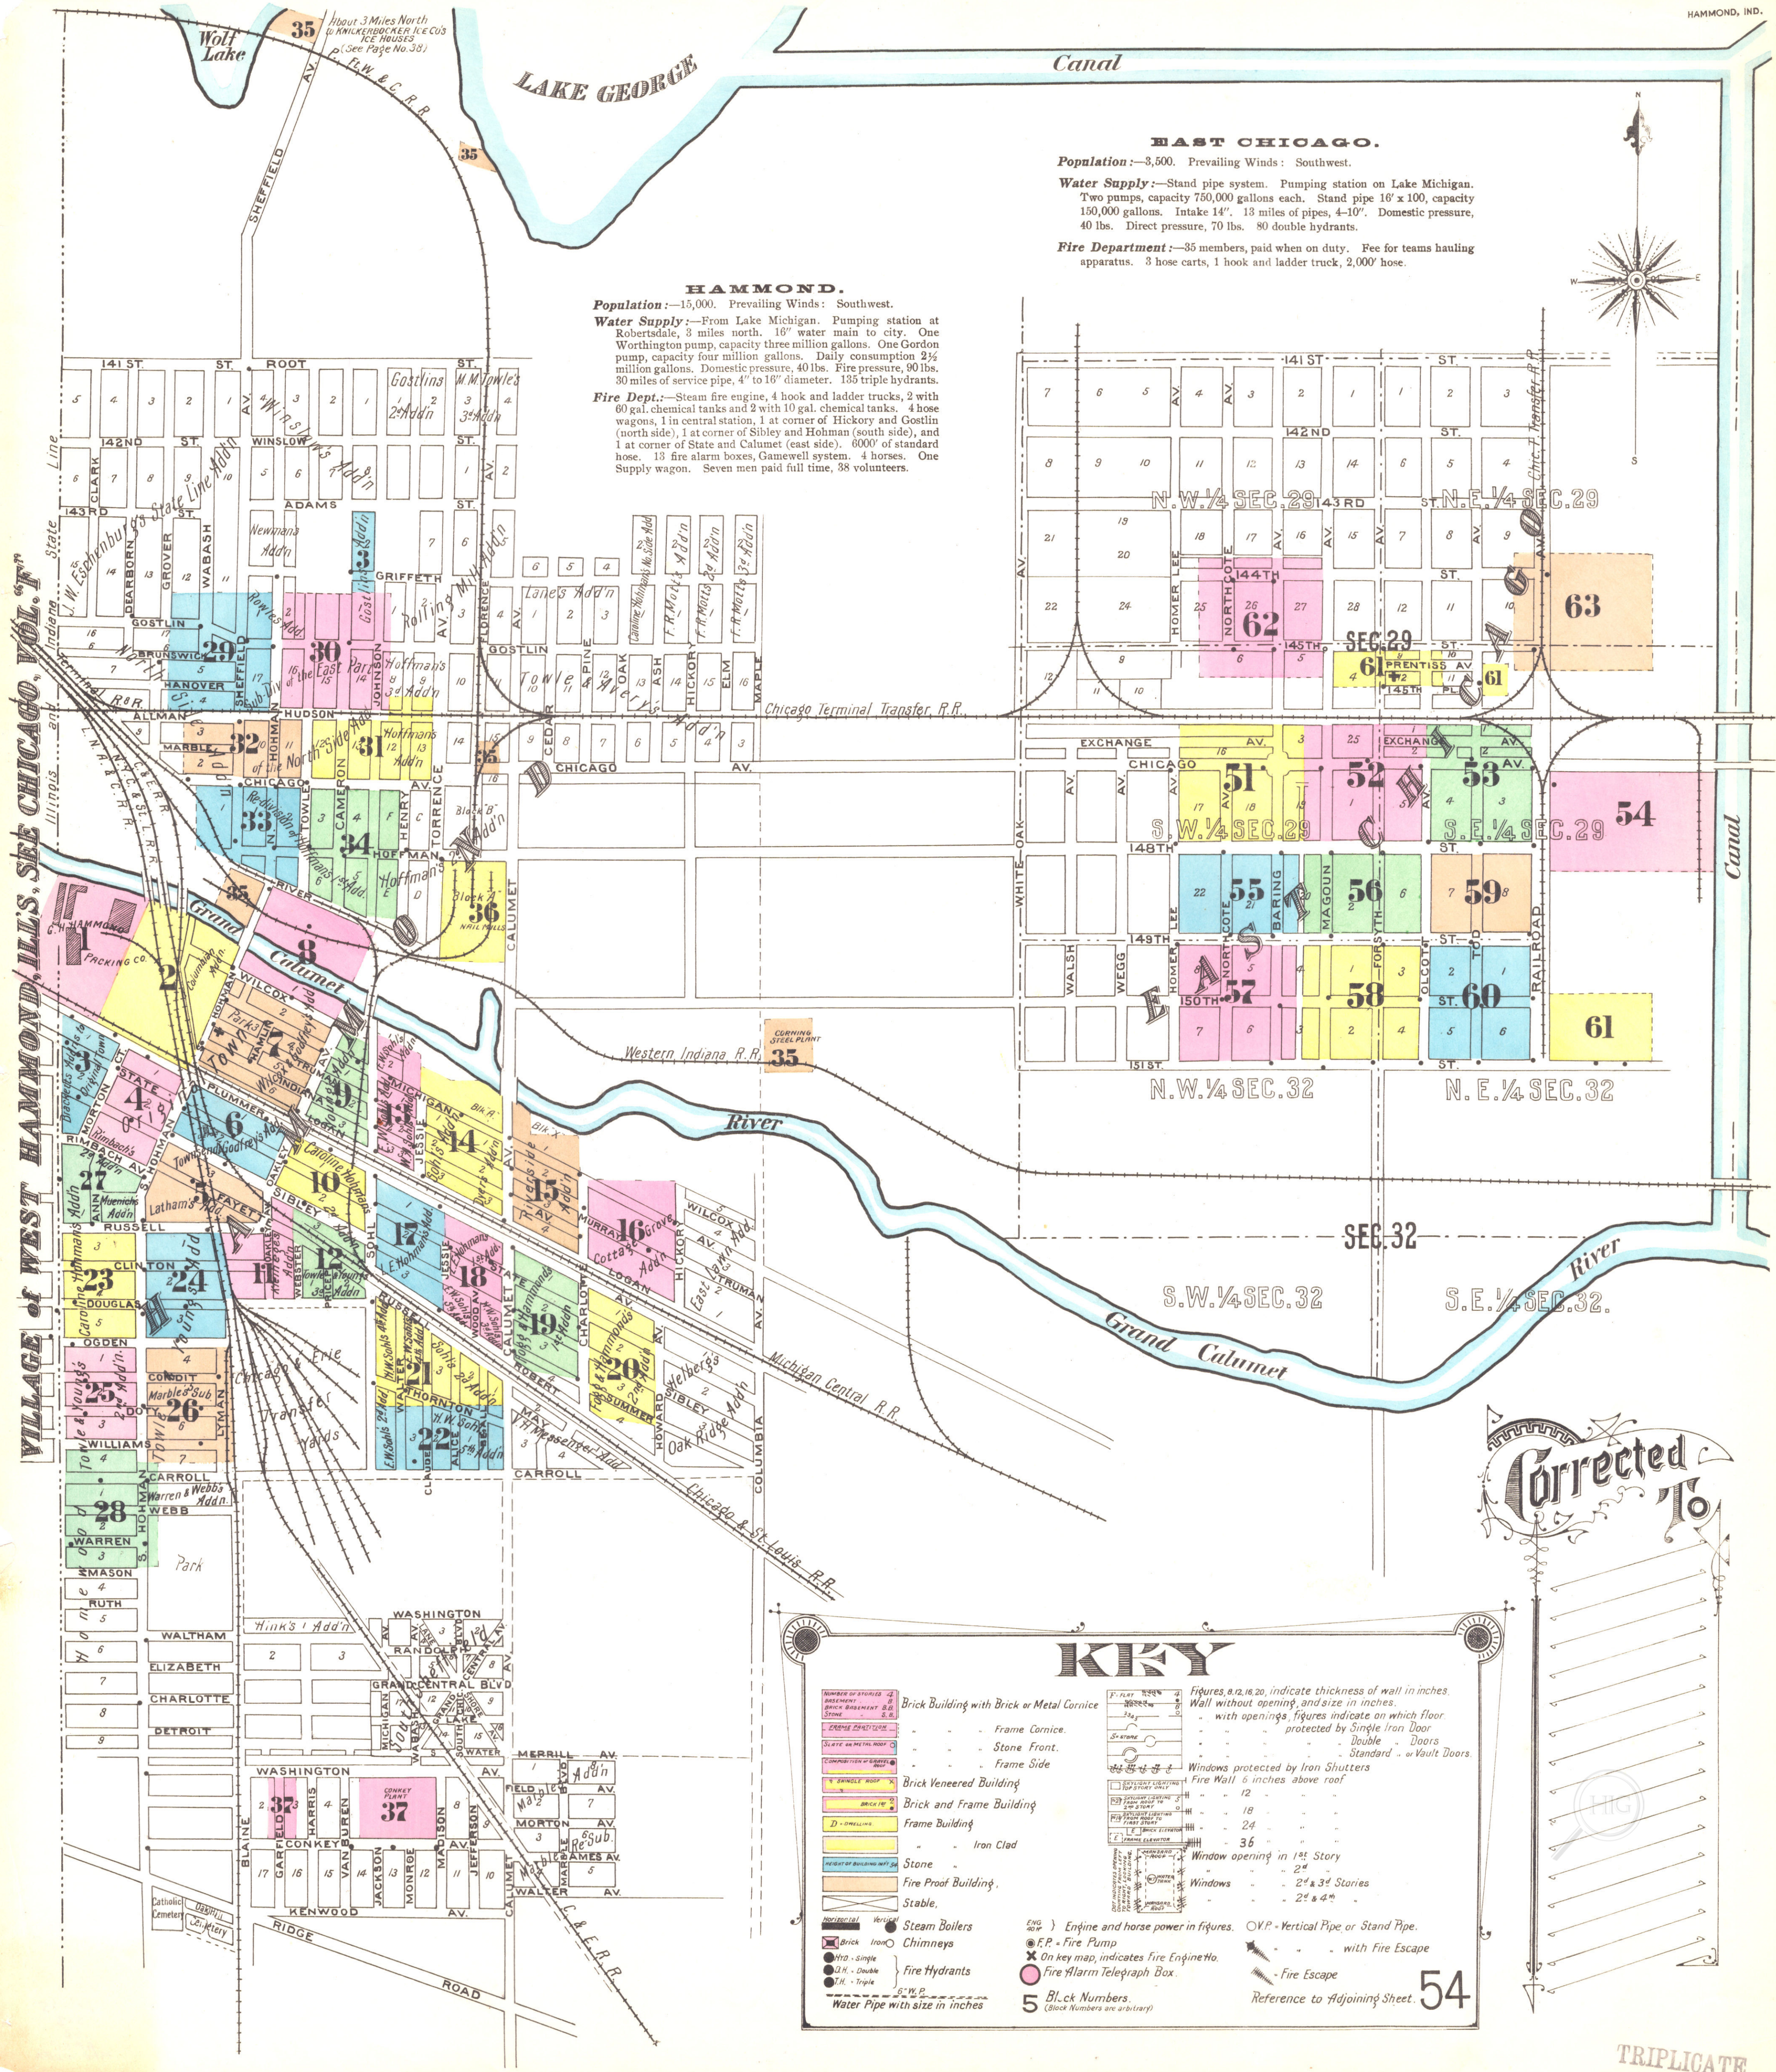

HAMMOND.
Population:—15,000. Prevailing Winds: Southwest.
Water Supply:—From Lake Michigan. Pumping station at
Robertsdale, 3 miles north. 16" water main to city. One
Worthington pump, capacity three million gallons. One Gordon
pump, capacity four million gallons. Daily consumption 2½
million gallons. Domestic pressure, 40 lbs. Fire pressure, 90 lbs.
30 miles of service pipe, 4" to 16" diameter. 135 triple hydrants.
Fire Dept.:—Steam fire engine, 4 hook and ladder trucks, 2 with
60 gal. chemical tanks and 2 with 10 gal. chemical tanks. 4 hose
wagons, 1 in central station, 1 at corner of Hickory and Gostlin
(north side), 1 at corner of Sibley and Hohman (south side), and
1 at corner of State and Calumet (east side). 6000' of standard
hose. 13 fire alarm boxes, Gamewell system. 4 horses. One
Supply wagon. Seven men paid full time, 38 volunteers.

EAST CHICAGO.
Population:—3,500. Prevailing Winds: Southwest.
Water Supply:—Stand pipe system. Pumping station on Lake Michigan.
Two pumps, capacity 750,000 gallons each. Stand pipe 16' x 100, capacity
150,000 gallons. Intake 14". 13 miles of pipes, 4-10". Domestic pressure,
40 lbs. Direct pressure, 70 lbs. 80 double hydrants.
Fire Department:—35 members, paid when on duty. Fee for teams hauling
apparatus. 3 hose carts, 1 hook and ladder truck, 2,000' hose.

KEY

NUMBER OF STORIES 4 BASEMENT BRICK BASEMENT 2 STONE	Brick Building with Brick or Metal Cornice	Figures 8, 12, 16, 20, indicate thickness of wall in inches. Wall without opening, and size in inches. with openings, figures indicate on which floor protected by Single Iron Door Double Doors Standard or Vault Doors
CRUISE CHIMNEY	Frame Cornice.	Windows protected by Iron Shutters
SLATE ON METAL ROOF	Stone Front.	Fire Wall 6 inches above roof
COMPOSITION OF GABLE ROOF	Frame Side	12
BRICK ROOF	Brick Veneered Building	18
D - DWELLING	Brick and Frame Building	24
HEIGHT OF BUILDING IN FT.	Frame Building	36
STONE	Iron Clad	Window opening in 1st Story
FIRE PROOF BUILDING	Stone	2nd & 3rd Stories
STABLE	Fire Proof Building	2nd & 4th
HORIZONTAL	Stable	
VERTICAL	Steam Boilers	
BRICK	Chimneys	
HYD - Single	Fire Hydrants	
D.H. - Double		
T.H. - Triple		
6" W.P.	Water Pipe with size in inches	

ENG. 40 H.P. } Engine and horse power in figures.
F.P. - Fire Pump
On key map, indicates Fire Engine No.
Fire Alarm Telegraph Box.
Blk. Numbers.
(Block Numbers are arbitrary)

O.V.P. - Vertical Pipe or Stand Pipe.
with Fire Escape
Fire Escape
Reference to Adjoining Sheet.

Corrected To

54

TRIPLICATE