


FEB. 1902
MUNCIE
IND.

Population 30,000. Prev. Winds, West

WATER FACILITIES. Water works owned by company of local stockholders. Water supply from 13-8" driven wells connected. Three suction pumps, 20x12x15, each capacity 2 1/2 million galls. each per 24 hours. One Worthington Duplex Pump, capacity 5 million galls. One Gordon Compound Duplex Pump, capacity 3 million galls. Total pumping capacity 13 million galls. 24 miles of water pipes, 42 to 16" diam. 261 double hydrants. Domestic pressure 40 lbs. Fire pressure 120 lbs.
FIRE DEPARTMENT. Fully paid, 19 Men, 8 Horses, 3 Engine Hoses. Gamewell fire alarm system, 42 boxes. Striker in each engine house, and in chiefs residence.
One third class Clapp & Jones steam fire engine.
One double tank chemical engine and hose wagon combined.
One hook & ladder truck - not used.
Two hose wagons.
8000 ft. 2 1/2" cotton hose.
Grades nearly level, streets mostly paved.

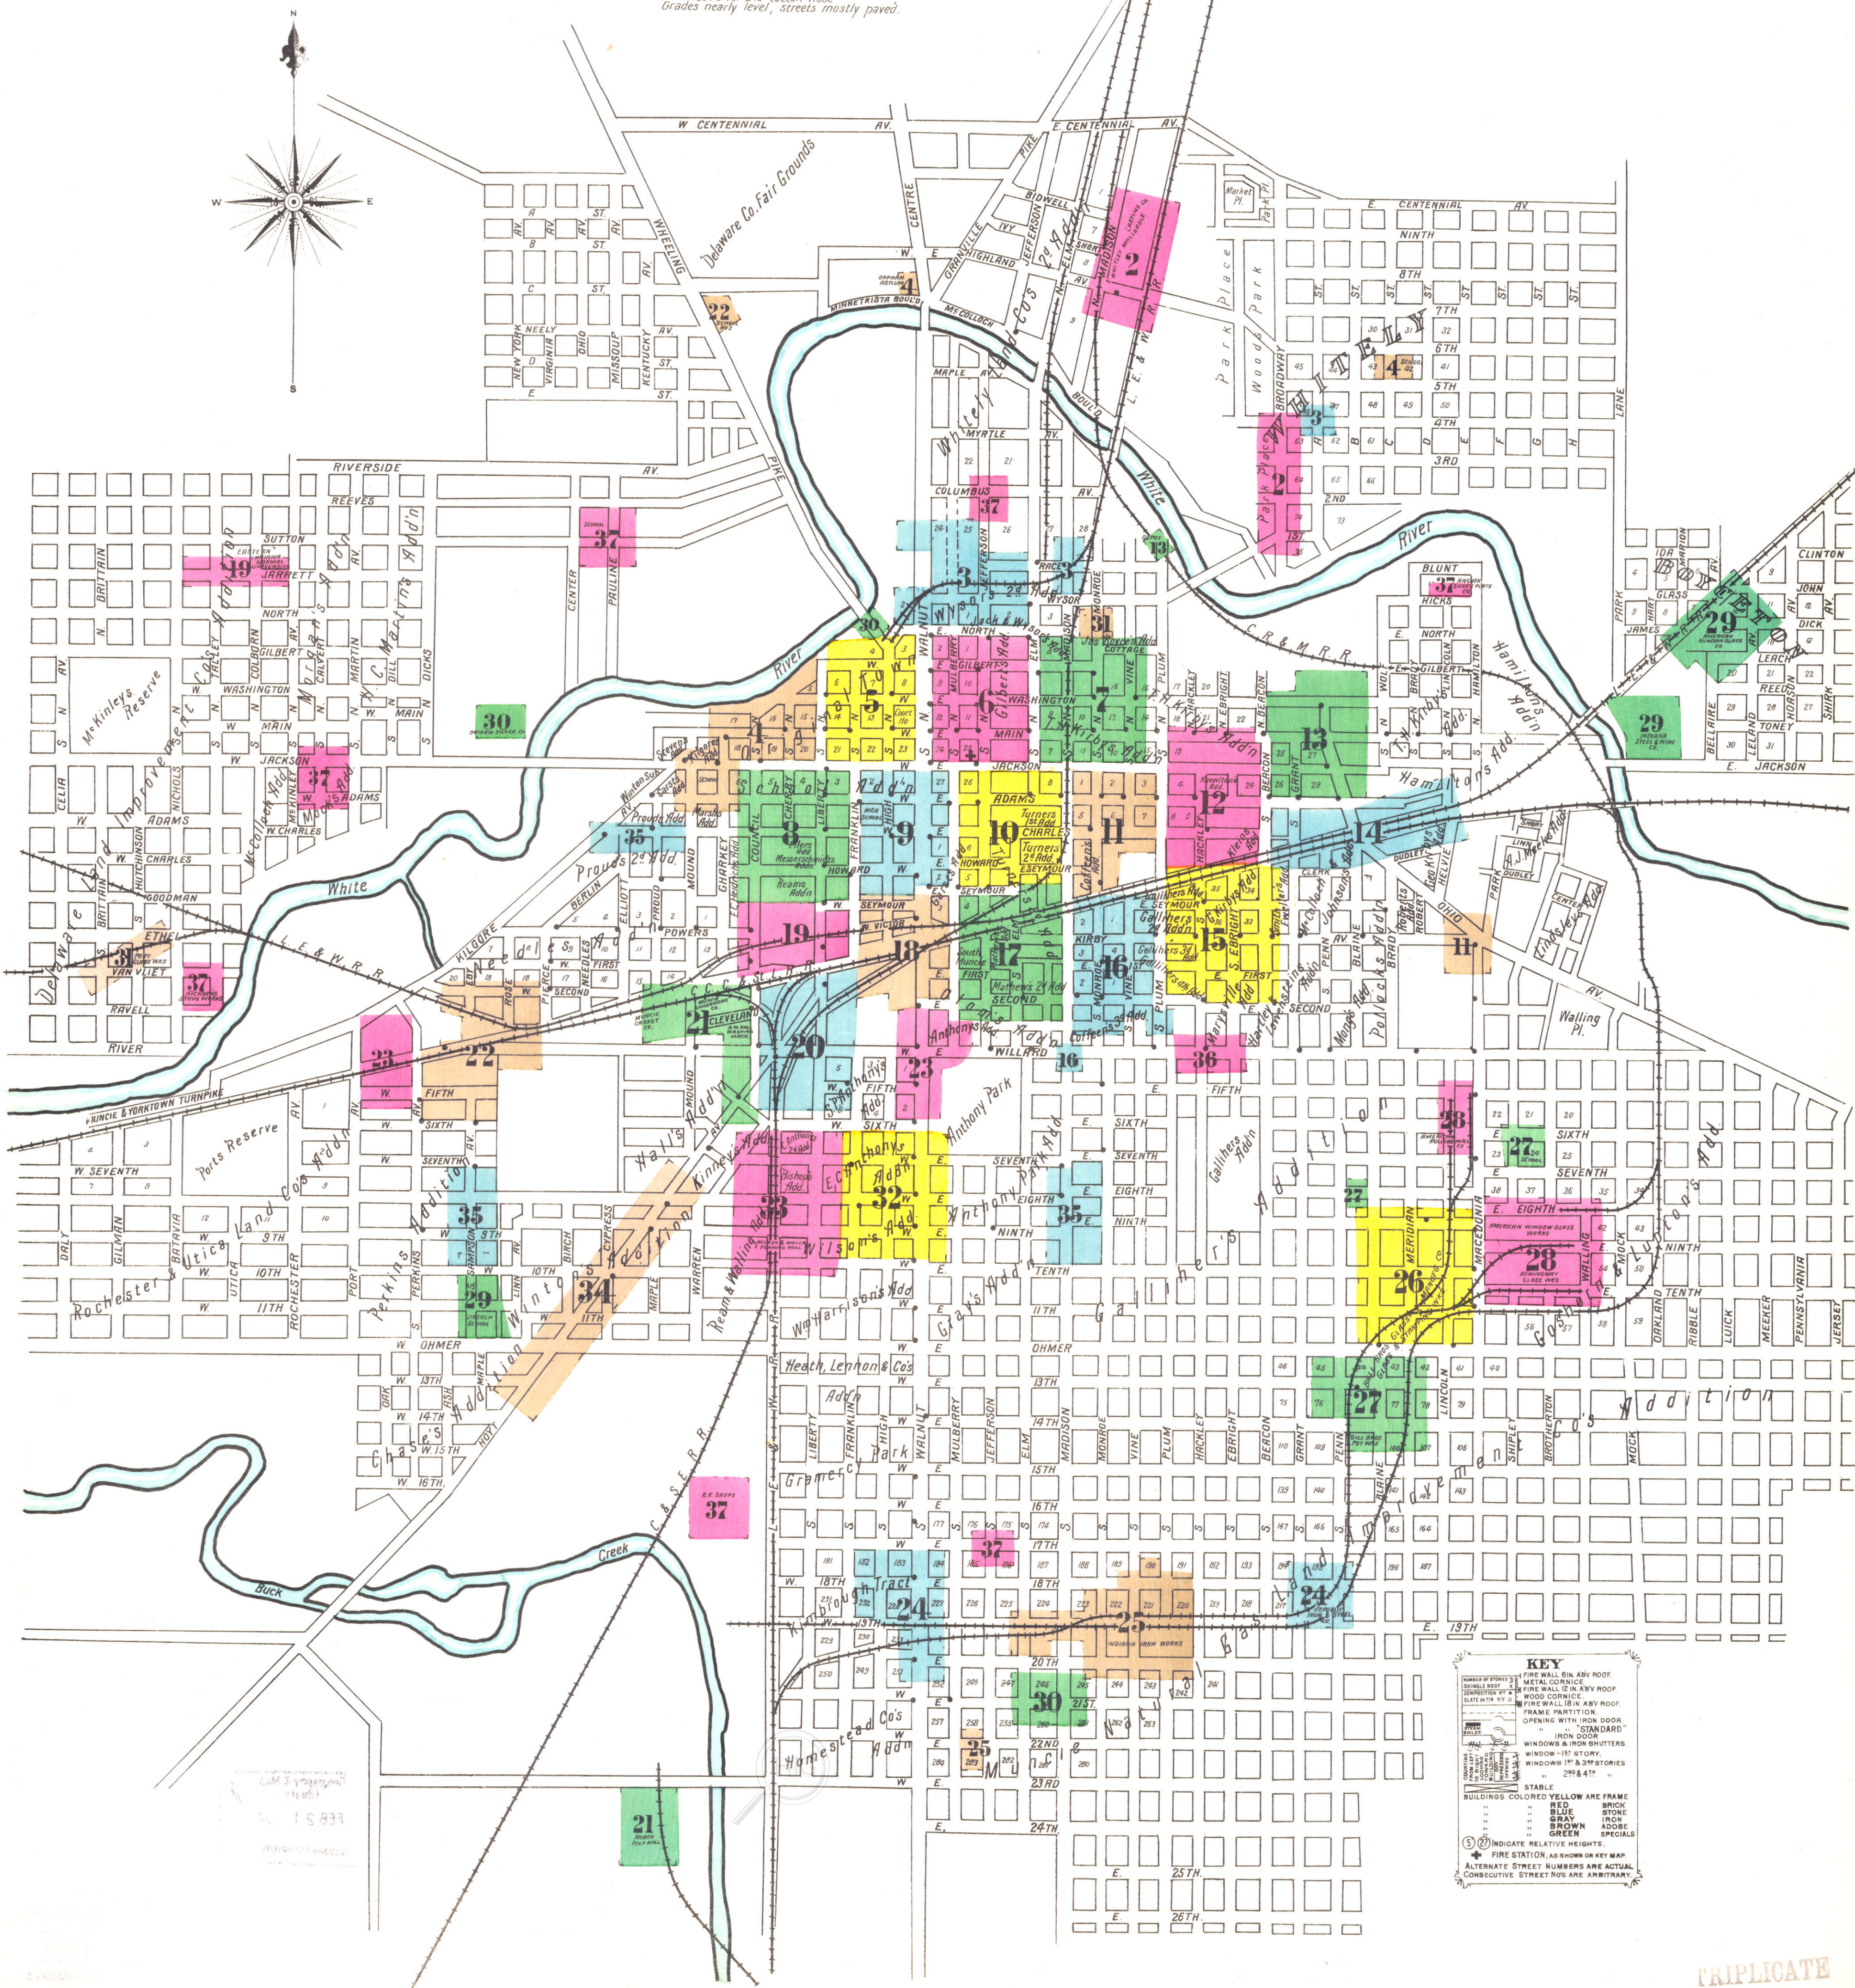

TRIPLICATE