




WATER FACILITIES
 Gravity & direct pressure system. Reservoir, elevated 25' above Wabash River, size 15x16 capacity 500,000 gals. Filled by 2 Worthington duplex fire pumps, size 8" x 16" each, capacity 300 gals. each per diem. Drawing from 7 driven wells. Domestic pressure 30 lbs. fire pressure 120 lbs. per square inch. Average daily consumption 27,000 gals. 2 Men on duty day & night. About 12 miles of water mains 4" to 12" laid in 1838 & 1839, 1910. 67 Hydrants.

FIRE DEPT
 Volunteer Co. One chief, 15 members, partly paid. 2 Hose carts, 500' 2" cotton rubber lined hose in good condition - 500' 2" C.R.L. hose in fairly good condition - 200' 2" rubber hose. One #3 L. truck - 230' ladders. 2 1/2" ladders. Fire alarm, telephone, whistle at Power Station & bell on fire ho.

streets partly brick paved - Grades rolling - Public lighting electric.

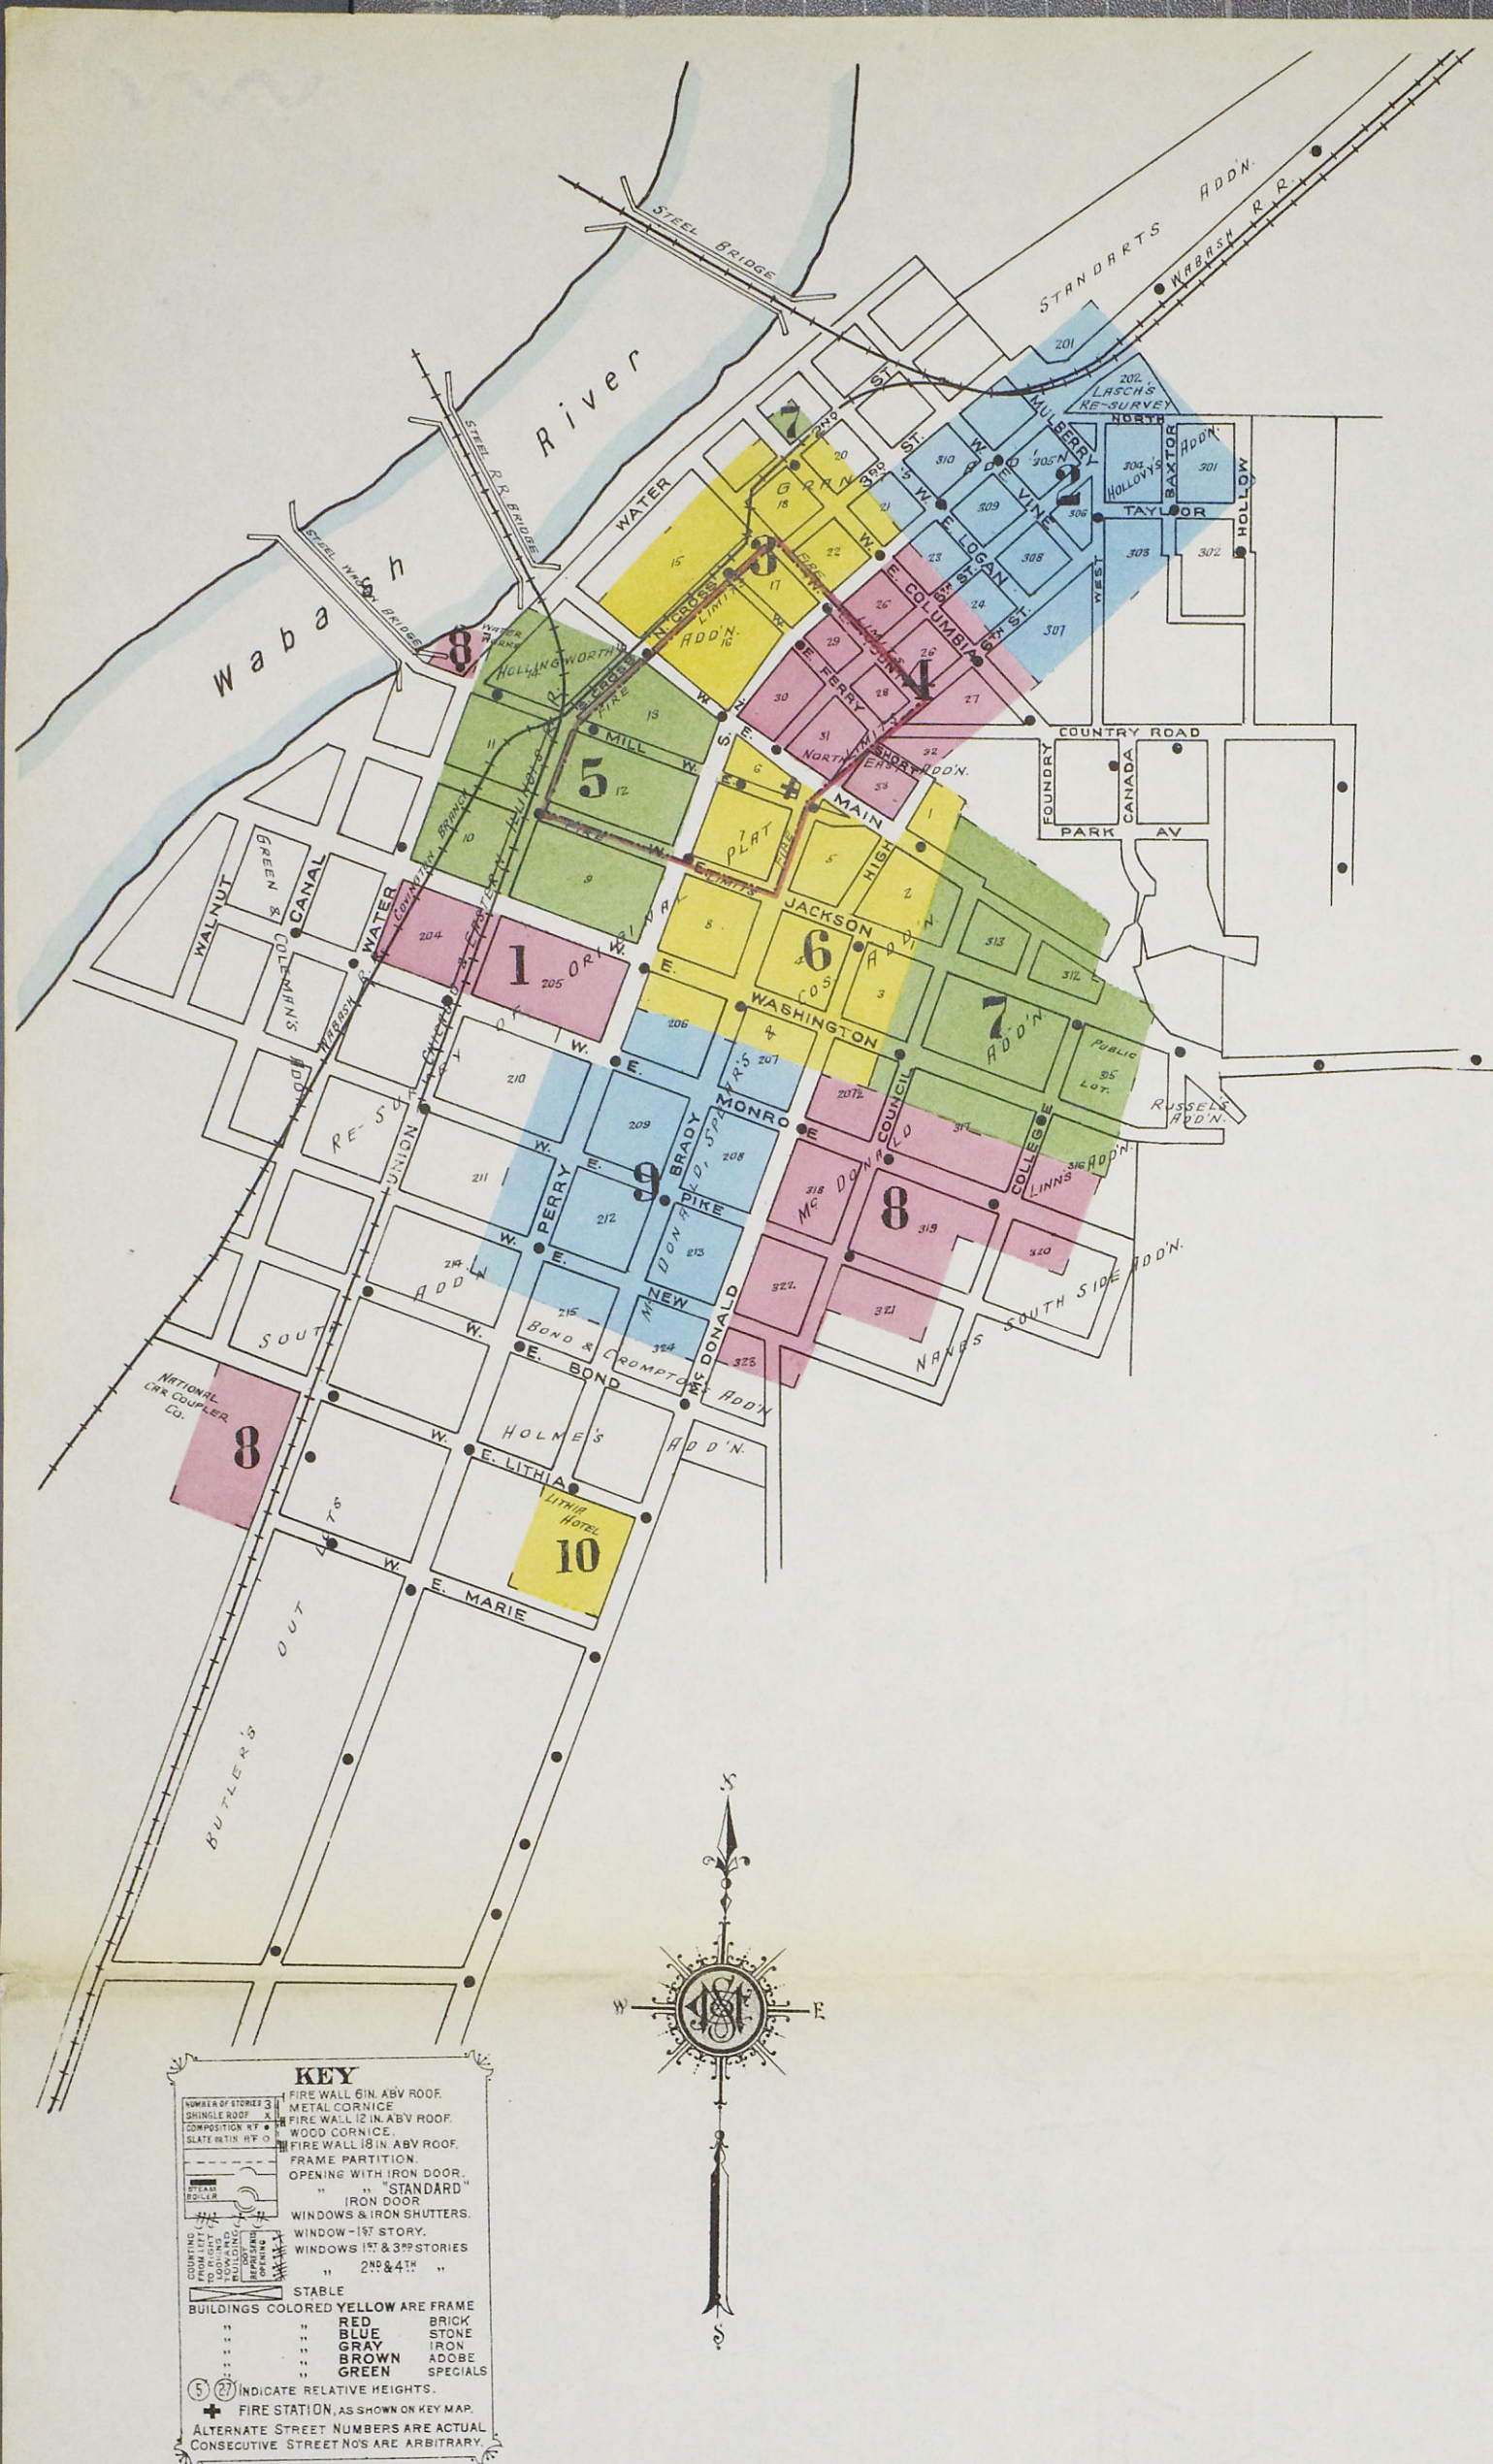

INDEX

STREETS.	SHEET	STREETS.	SHEET
Baxter, E.	100-207	Vine, E.	100-207
Brady, W.	100-403	W.	100-107
	404-705		
Canada, C.	100-303	Washington, E.	100-303
College, C.	100-403	W.	100-307
Columbia, E.	100-313	W.	100-210
	100-209	West, W.	101-209
	300-304		100-309
	301-307		
Council, C.	100-303	Yount, E.	100-209
	304-607	W.	100-217
County Road, C.	100-113		
Cross, N.	100-111		
	100-111		
Ferry, E.	100-209		
Fifth, W.	100-109		
	100-403		
	404-607		
High, N.	100-106		
	101-106		
Holloy, S.	100-107		
	100-107		
Jackson, E.	100-305		
	306-505		
	100-209		
Lithia, E.	100-113		
	100-207		
Monroe, E.	100-207		
	300-503		
	100-210		
	101-106		
Mulberry, W.	100-107		
	100-107		
New, E.	100-207		
	300-307		
	100-105		
North, W.	100-207		
	100-207		
Perry, N.	100-404		
	101-403		
	405-804		
	100-306		
	101-403		
	400-408		
	405-409		
	500-705		
Pike, E.	100-207		
	300-407		
	100-103		
Second, S.	300-309		
	400-404		
	401-403		
Short, S.	300-313		
	100-403		
Sixth, S.	404-603		
	404-603		
Taylor, T.	300-407		
	300-403		
Third, T.	405-603		
	405-603		
Union, U.	200-311		
	400-409		
	near W. Lithia		

* Indicates only one side of Street shown.

