


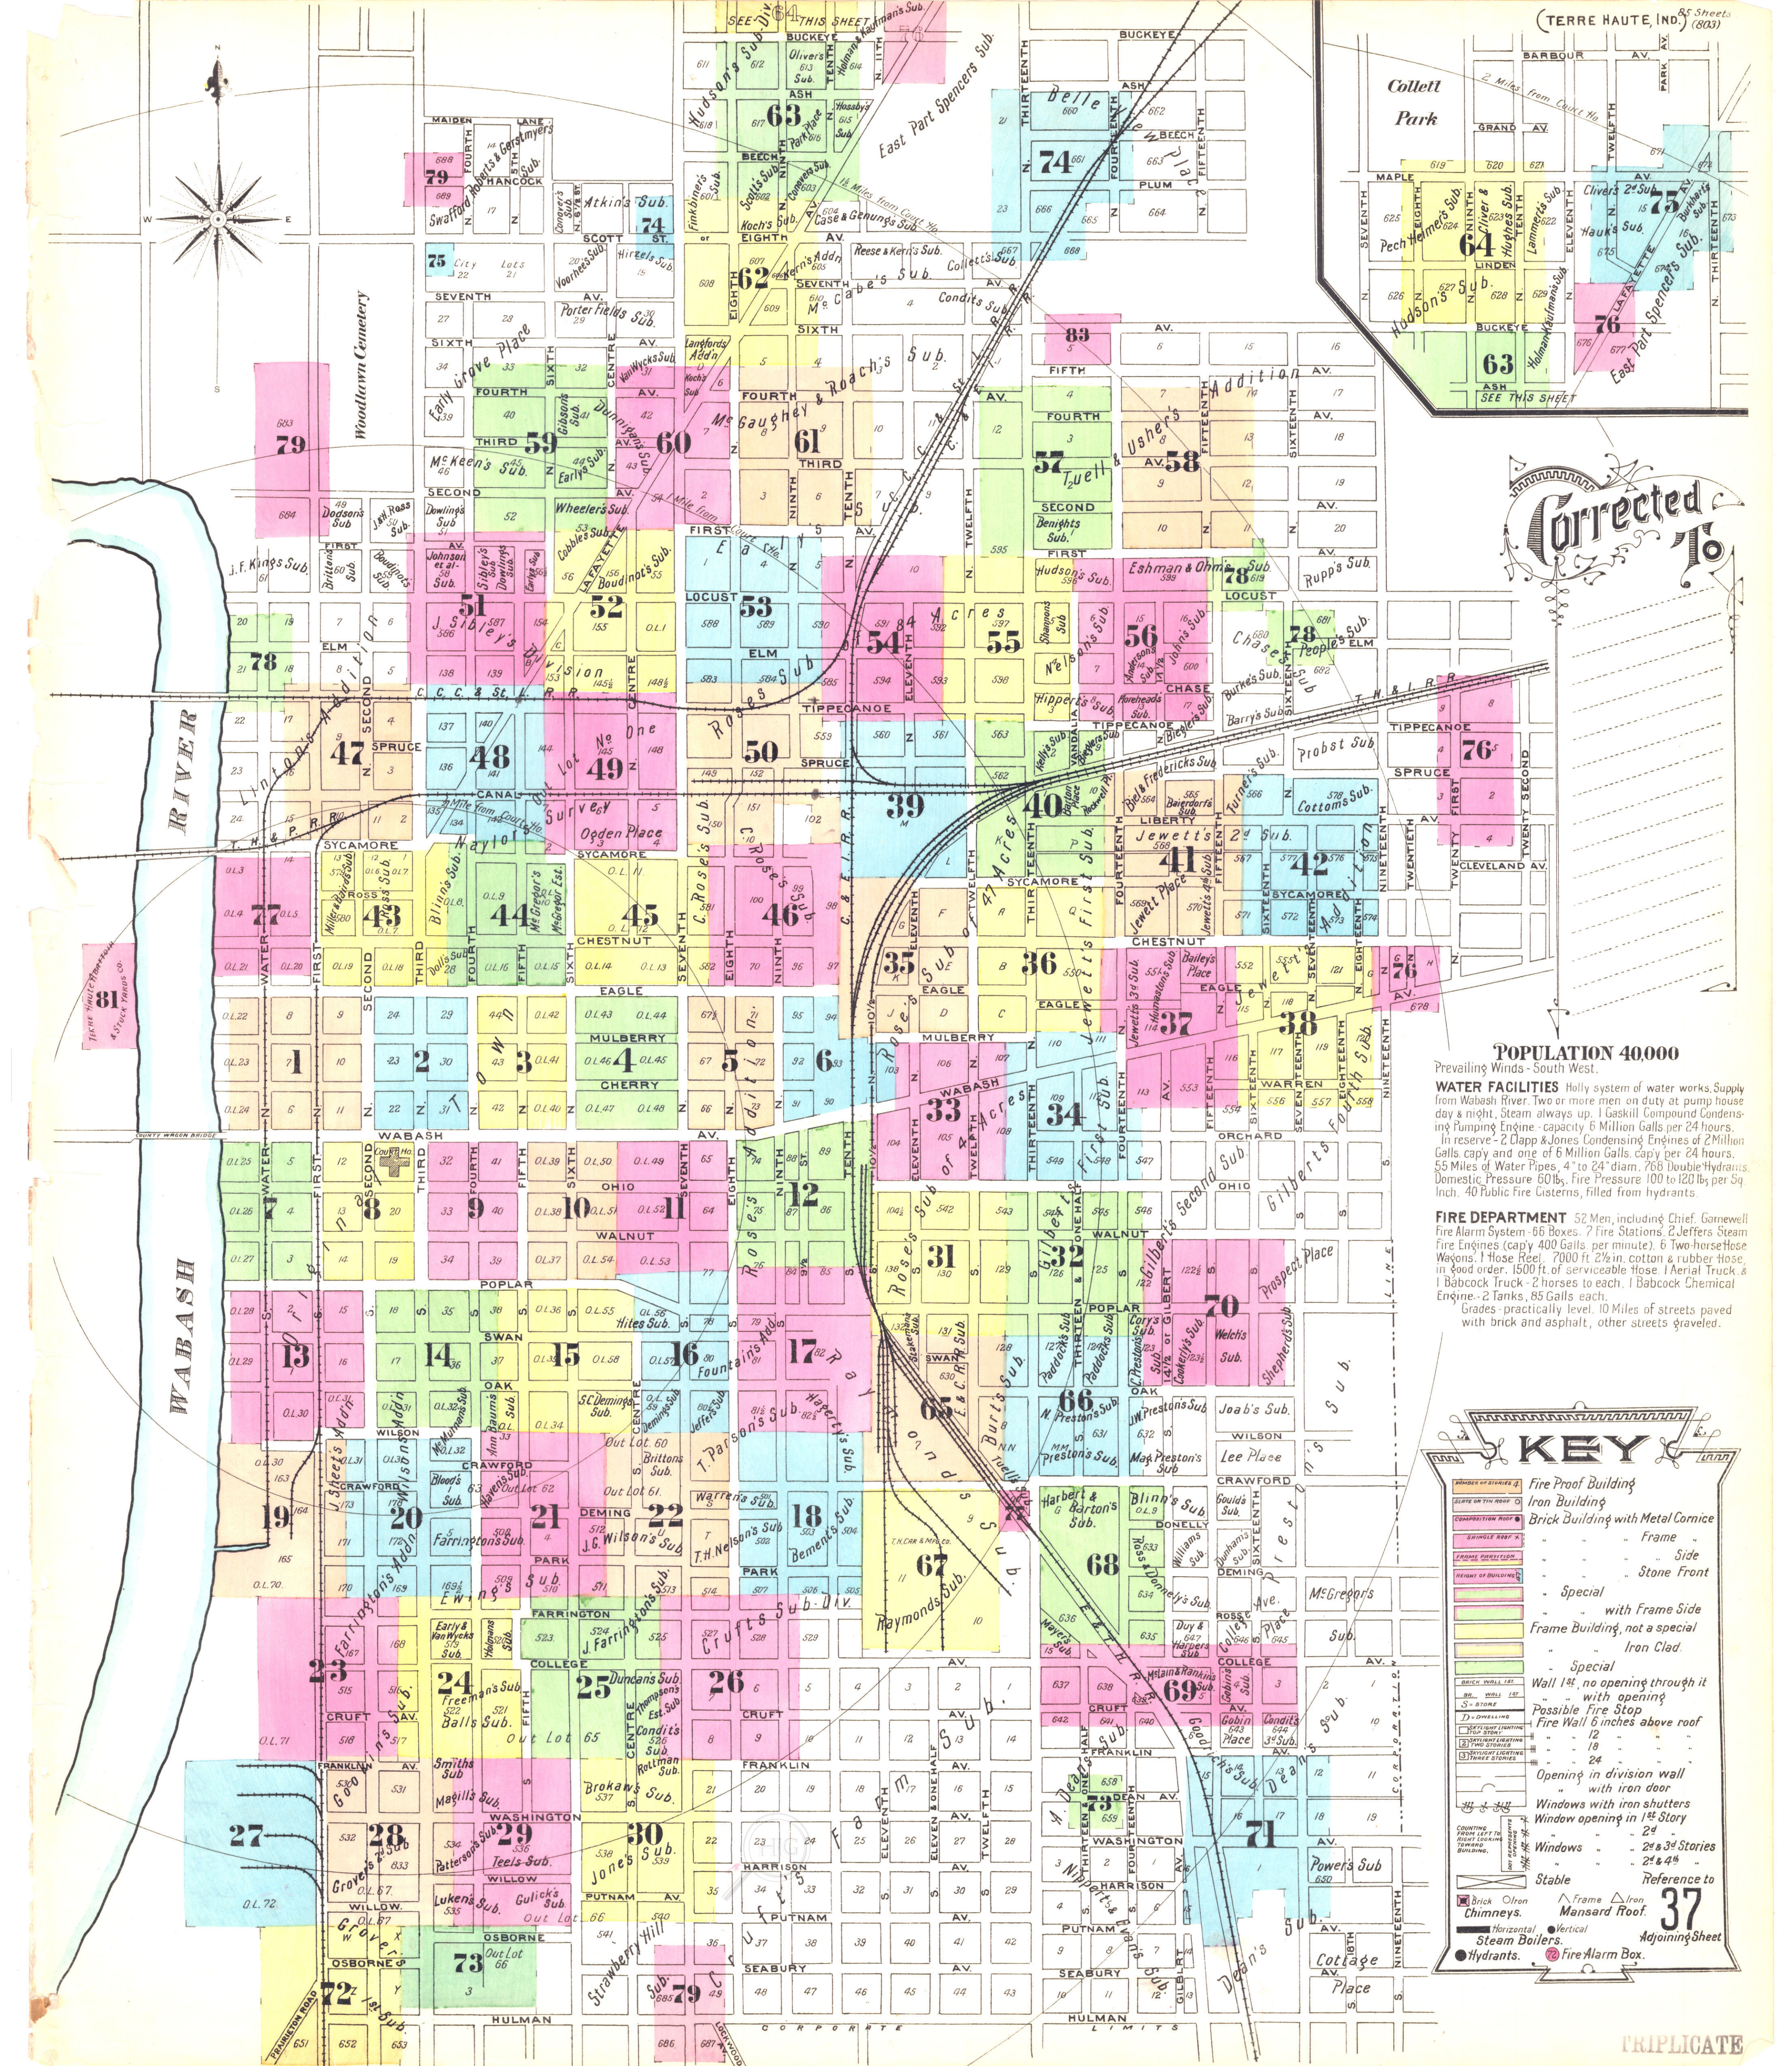

Corrected 37

POPULATION 40,000

Prevailing Winds - South West.
WATER FACILITIES Holly system of water works. Supply from Wabash River. Two or more men on duty at pump house day & night. Steam always up. 1 Gaskill Compound Condensing Pumping Engine - capacity 6 Million Galls. per 24 hours. In reserve - 2 Clapp & Jones Condensing Engines of 2 Million Galls. capy and one of 6 Million Galls. capy per 24 hours. 55 Miles of Water Pipes, 4" to 24" diam. 768 Double Hydrants. Domestic Pressure 60 lbs. Fire Pressure 100 to 120 lbs. per Sq. Inch. 40 Public Fire Cisterns, filled from hydrants.

FIRE DEPARTMENT 52 Men, including Chief. Gamewell Fire Alarm System - 66 Boxes. 7 Fire Stations. 2 Jeffers Steam Fire Engines (capy 400 Galls. per minute). 6 Two-horse Hose Wagons. 1 Hose Reel. 7000 ft. 2 1/2 in. cotton & rubber hose. In good order. 1500 ft. of serviceable hose. 1 Aerial Truck. & 1 Babcock Truck - 2 horses to each. 1 Babcock Chemical Engine - 2 Tanks, 85 Galls. each.
Grades - practically level. 10 Miles of streets paved with brick and asphalt, other streets graveled.

KEY

Fire Proof Building	Iron Building	Brick Building with Metal Cornice
Shingle Roof	Frame	Side
Stone Front	Special	with Frame Side
Iron Clad	Special	Wall 1st, no opening through it
Possible Fire Stop	Fire Wall 6 inches above roof	12
18	24	Opening in division wall with iron door
Windows with iron shutters	Window opening in 1st Story	2d
Windows	2d & 3d Stories	2d & 4th
Stable	Reference to	37
Brick Chimney	Frame Chimney	Mansard Roof
Horizontal Steam Boilers	Vertical Steam Boilers	Hydrants
Fire Alarm Box	Adjoining Sheet	