

INDEX.

STREETS.	SHEET	SPECIALS.	SHEET
Cherry,	C	Albion Hotel,	A
Elm,	E	Annex Hotel,	2
Hazel,	H	Atwood Buggy Co.,	3
Highland,	1 & 2	Baptist Church,	B
Jefferson,	1, 2 & 4	B. & O. R. R. Depot,	2
Liberty,	1, 3 & 4	E. & O. Elevator,	3
Main,	2 & 4	City Elec. Light and Water-works P.W.,	3
Oak,	2	Clear, R. B., & Son, Saw-mill,	3
Orange,	2, 3 & 4	Cottage Hotel,	4
Owen,	4	County Court House,	2
Railroad,	R	Jail,	2
South,	S	Croft, B. F., Flour and Planing-mill,	3
Wall,	W	Landgraf, F., Tile-works,	4
Washington,	3	Lutheran Church,	1
York,	2 & 3	Methodist Episcopal Church,	3
		Opera House,	2
		Orange Street Mission,	3
		Presbyterian Church,	2
		Public School,	4
		Steam Heating Plant,	2




THE LIBRARY OF CONGRESS
MAR. 6 1901
Copyright Entry
May 6 1909
CLASS. 2. 300. N. 2
COPY B

Library of Congress
No. 2. 3. 15
Maps & Charts

KEY

1 FIRE WALL, 5 IN. ASB. ROOF
2 FIRE WALL, 5 IN. ASB. ROOF
3 FIRE WALL, 5 IN. ASB. ROOF
4 FIRE WALL, 5 IN. ASB. ROOF
5 FIRE WALL, 5 IN. ASB. ROOF
6 FIRE WALL, 5 IN. ASB. ROOF
7 FIRE WALL, 5 IN. ASB. ROOF
8 FIRE WALL, 5 IN. ASB. ROOF
9 FIRE WALL, 5 IN. ASB. ROOF
10 FIRE WALL, 5 IN. ASB. ROOF
11 FIRE WALL, 5 IN. ASB. ROOF
12 FIRE WALL, 5 IN. ASB. ROOF
13 FIRE WALL, 5 IN. ASB. ROOF
14 FIRE WALL, 5 IN. ASB. ROOF
15 FIRE WALL, 5 IN. ASB. ROOF
16 FIRE WALL, 5 IN. ASB. ROOF
17 FIRE WALL, 5 IN. ASB. ROOF
18 FIRE WALL, 5 IN. ASB. ROOF
19 FIRE WALL, 5 IN. ASB. ROOF
20 FIRE WALL, 5 IN. ASB. ROOF
21 FIRE WALL, 5 IN. ASB. ROOF
22 FIRE WALL, 5 IN. ASB. ROOF
23 FIRE WALL, 5 IN. ASB. ROOF
24 FIRE WALL, 5 IN. ASB. ROOF
25 FIRE WALL, 5 IN. ASB. ROOF
26 FIRE WALL, 5 IN. ASB. ROOF
27 FIRE WALL, 5 IN. ASB. ROOF
28 FIRE WALL, 5 IN. ASB. ROOF
29 FIRE WALL, 5 IN. ASB. ROOF
30 FIRE WALL, 5 IN. ASB. ROOF
31 FIRE WALL, 5 IN. ASB. ROOF
32 FIRE WALL, 5 IN. ASB. ROOF
33 FIRE WALL, 5 IN. ASB. ROOF
34 FIRE WALL, 5 IN. ASB. ROOF
35 FIRE WALL, 5 IN. ASB. ROOF
36 FIRE WALL, 5 IN. ASB. ROOF
37 FIRE WALL, 5 IN. ASB. ROOF
38 FIRE WALL, 5 IN. ASB. ROOF
39 FIRE WALL, 5 IN. ASB. ROOF
40 FIRE WALL, 5 IN. ASB. ROOF
41 FIRE WALL, 5 IN. ASB. ROOF
42 FIRE WALL, 5 IN. ASB. ROOF
43 FIRE WALL, 5 IN. ASB. ROOF
44 FIRE WALL, 5 IN. ASB. ROOF
45 FIRE WALL, 5 IN. ASB. ROOF
46 FIRE WALL, 5 IN. ASB. ROOF
47 FIRE WALL, 5 IN. ASB. ROOF
48 FIRE WALL, 5 IN. ASB. ROOF
49 FIRE WALL, 5 IN. ASB. ROOF
50 FIRE WALL, 5 IN. ASB. ROOF
51 FIRE WALL, 5 IN. ASB. ROOF
52 FIRE WALL, 5 IN. ASB. ROOF
53 FIRE WALL, 5 IN. ASB. ROOF
54 FIRE WALL, 5 IN. ASB. ROOF
55 FIRE WALL, 5 IN. ASB. ROOF
56 FIRE WALL, 5 IN. ASB. ROOF
57 FIRE WALL, 5 IN. ASB. ROOF
58 FIRE WALL, 5 IN. ASB. ROOF
59 FIRE WALL, 5 IN. ASB. ROOF
60 FIRE WALL, 5 IN. ASB. ROOF
61 FIRE WALL, 5 IN. ASB. ROOF
62 FIRE WALL, 5 IN. ASB. ROOF
63 FIRE WALL, 5 IN. ASB. ROOF
64 FIRE WALL, 5 IN. ASB. ROOF
65 FIRE WALL, 5 IN. ASB. ROOF
66 FIRE WALL, 5 IN. ASB. ROOF
67 FIRE WALL, 5 IN. ASB. ROOF
68 FIRE WALL, 5 IN. ASB. ROOF
69 FIRE WALL, 5 IN. ASB. ROOF
70 FIRE WALL, 5 IN. ASB. ROOF
71 FIRE WALL, 5 IN. ASB. ROOF
72 FIRE WALL, 5 IN. ASB. ROOF
73 FIRE WALL, 5 IN. ASB. ROOF
74 FIRE WALL, 5 IN. ASB. ROOF
75 FIRE WALL, 5 IN. ASB. ROOF
76 FIRE WALL, 5 IN. ASB. ROOF
77 FIRE WALL, 5 IN. ASB. ROOF
78 FIRE WALL, 5 IN. ASB. ROOF
79 FIRE WALL, 5 IN. ASB. ROOF
80 FIRE WALL, 5 IN. ASB. ROOF
81 FIRE WALL, 5 IN. ASB. ROOF
82 FIRE WALL, 5 IN. ASB. ROOF
83 FIRE WALL, 5 IN. ASB. ROOF
84 FIRE WALL, 5 IN. ASB. ROOF
85 FIRE WALL, 5 IN. ASB. ROOF
86 FIRE WALL, 5 IN. ASB. ROOF
87 FIRE WALL, 5 IN. ASB. ROOF
88 FIRE WALL, 5 IN. ASB. ROOF
89 FIRE WALL, 5 IN. ASB. ROOF
90 FIRE WALL, 5 IN. ASB. ROOF
91 FIRE WALL, 5 IN. ASB. ROOF
92 FIRE WALL, 5 IN. ASB. ROOF
93 FIRE WALL, 5 IN. ASB. ROOF
94 FIRE WALL, 5 IN. ASB. ROOF
95 FIRE WALL, 5 IN. ASB. ROOF
96 FIRE WALL, 5 IN. ASB. ROOF
97 FIRE WALL, 5 IN. ASB. ROOF
98 FIRE WALL, 5 IN. ASB. ROOF
99 FIRE WALL, 5 IN. ASB. ROOF
100 FIRE WALL, 5 IN. ASB. ROOF

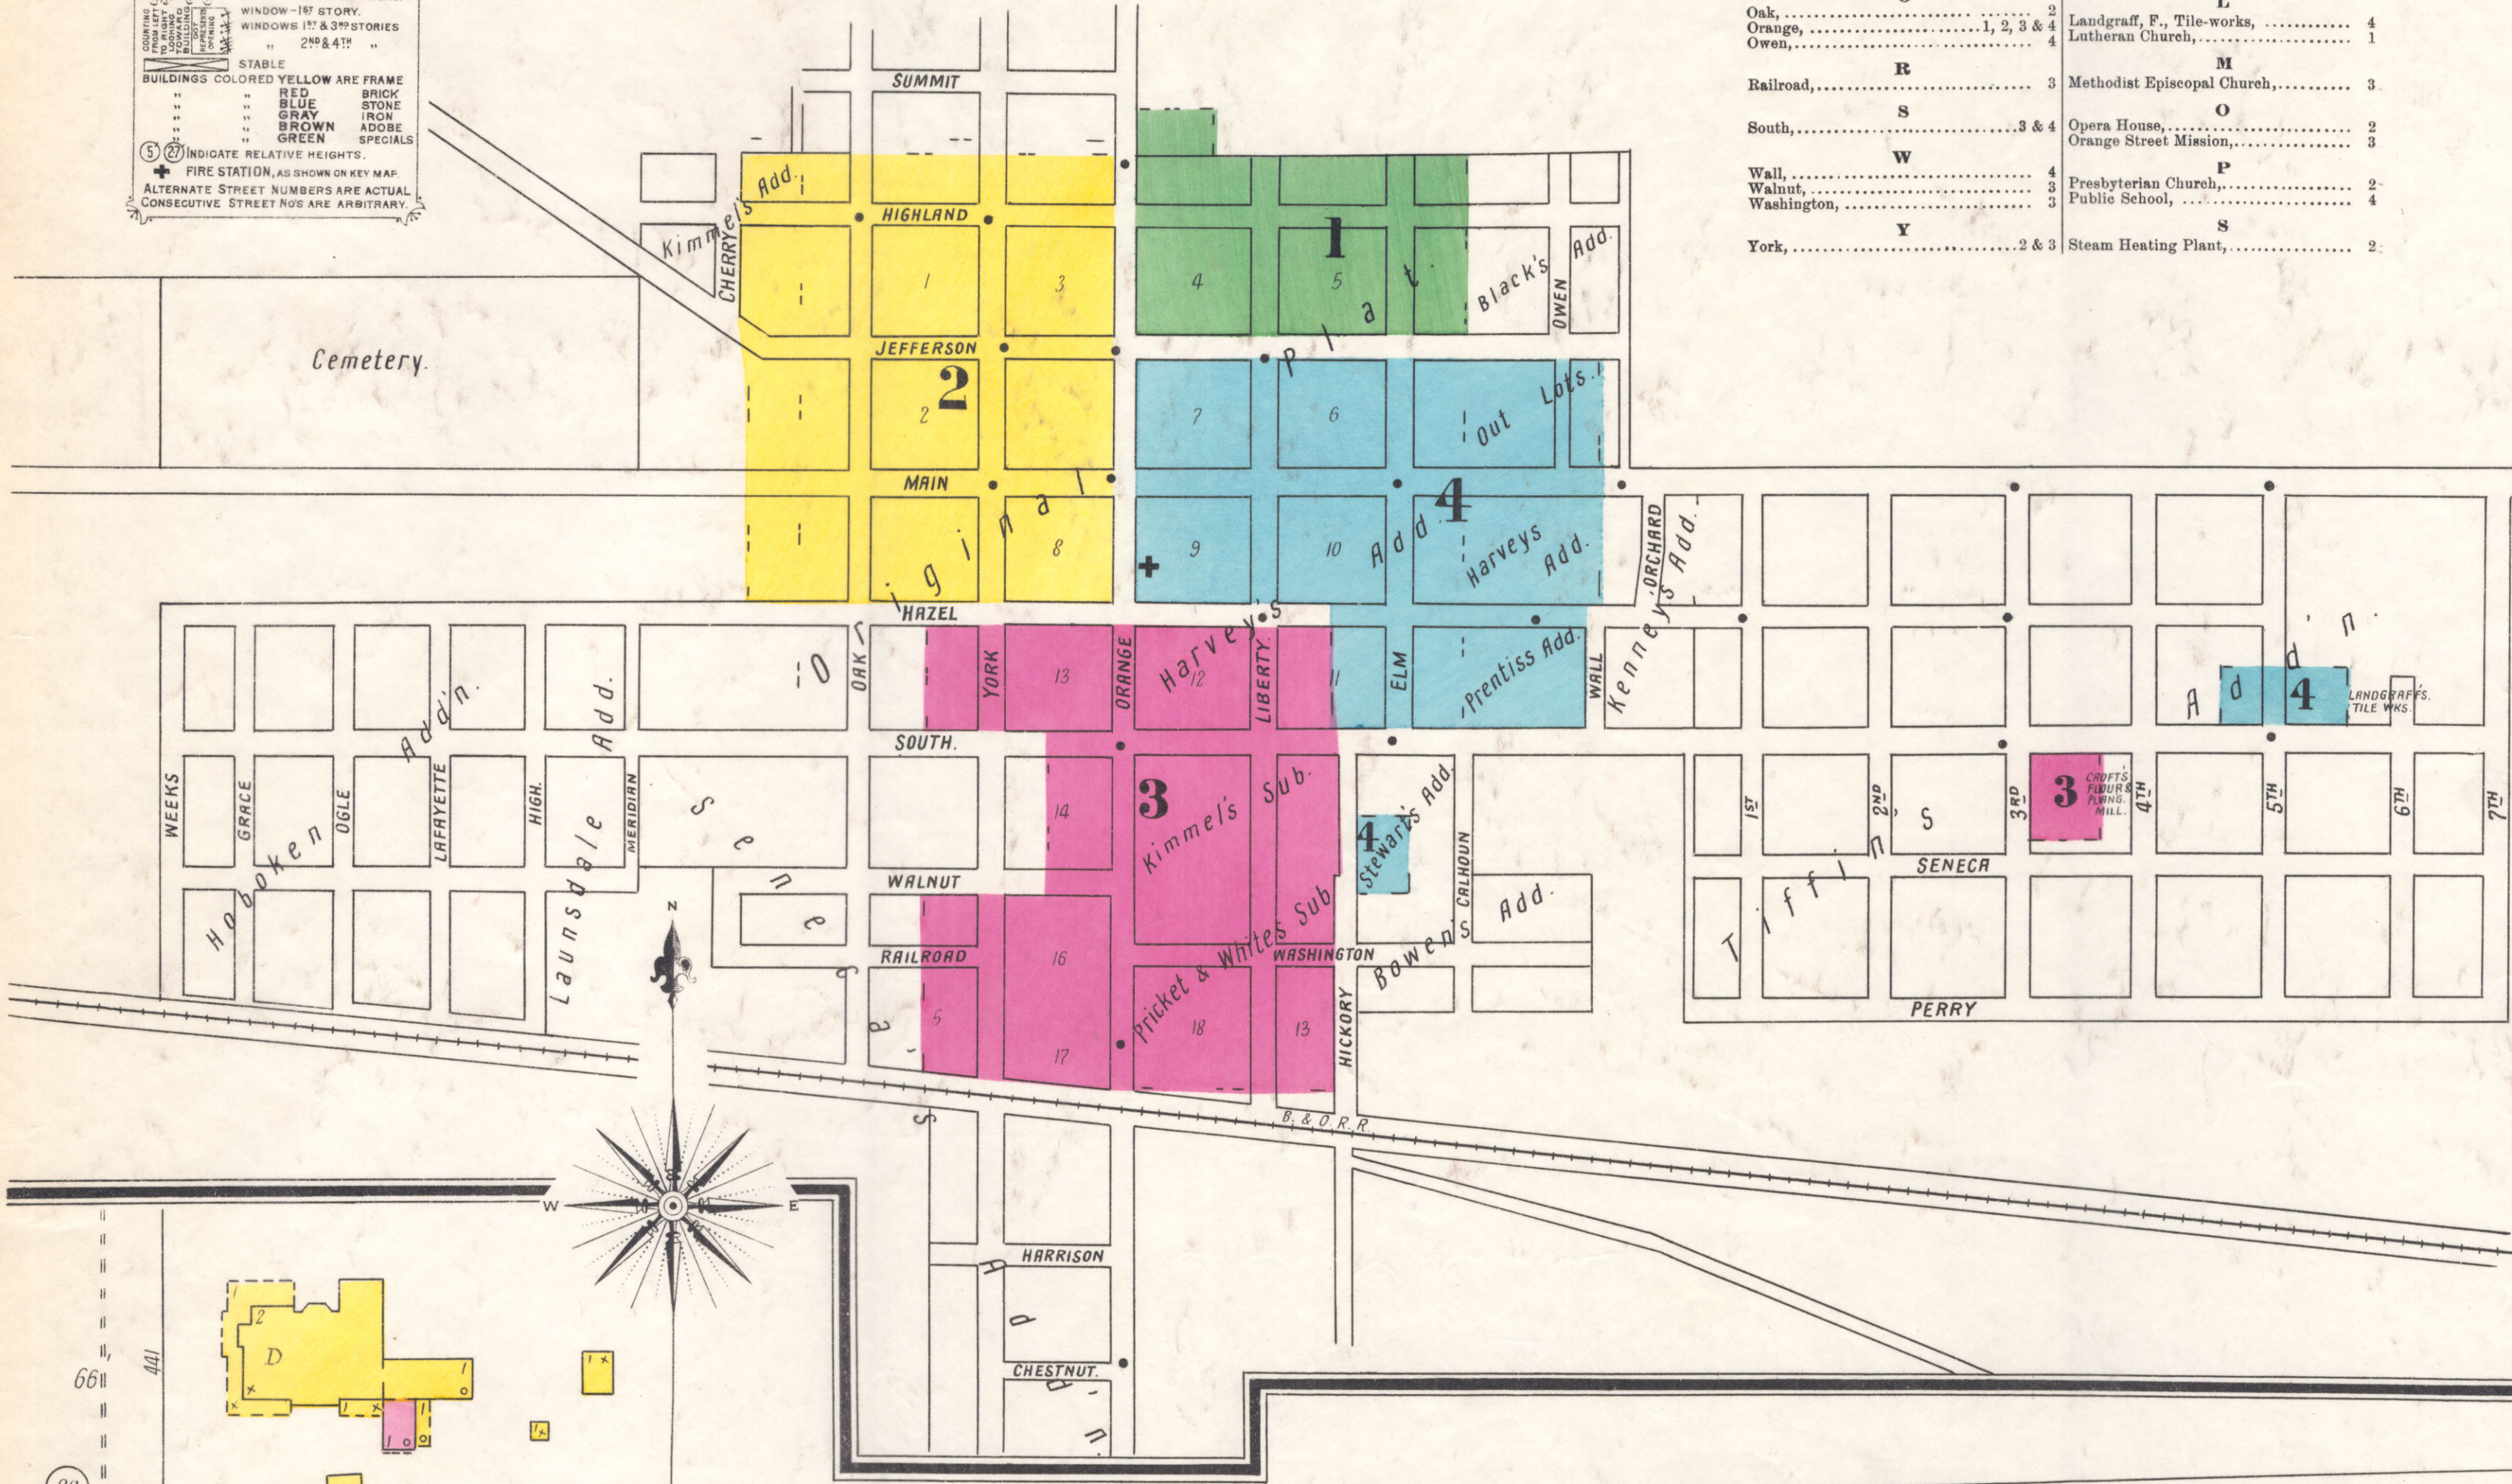

Note.
Water Facilities. 2 DUPLEX WORTHINGTON PUMPS.
12 MILL. GAL. CAPY. EACH PER 24 HOURS SUPPLY DRAWN
FROM 5' - 6' WELLS, 100' DEEP AVE. DAILY CONSUMPTION,
75000 GALS. COMMERCIAL PRESSURE 50 TO 70 LBS.
FIRE PRESSURE 100 LBS. 24 D. HYDS. 2 MILES WATER
WINDING. 4" TO 10"
Fire Dept. 2 HOSE CHITS 800' 2 1/2" HOSE 'NEW'
1 H & L TRUCK. VOL. CO. 28 MEN. PAID EACH CALL.

