


WATER FACILITIES

Direct pressure. 2 Gordon steam pumps, capacity 3/4 million gal each per 24 hours. 5, 6 wells, 118' deep. Domestic pressure 40 lbs. & fire pressure 30 lbs. per square inch. Daily consumption about 300,000 gals. About 5 miles of 4" tall. Water mains laid in 1893 & 1903. 3 triple & double hydrants.

FIRE DEPT.

45 Volunteer fire men. 2 Hand hose carts. One Hand Ladder Wagon. 2000' 2" cotton rubber lined hose. Fire alarm whistle at Water Works Plant. Condition of streets, Detroit, Michigan & Spring. Streets brick paved in business section. All other streets, unpaved & graded. Public lighting elec.

OCT 15 1910

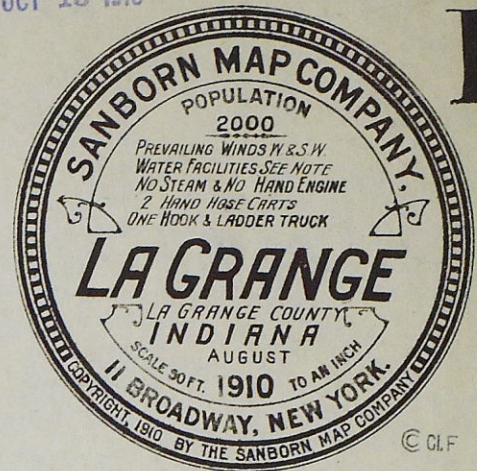


INDEX.

STREETS.	SHEET	SPECIALS.	SHEET
Canal, C	25-26 4	Baptist Church, B	5
" " " " " "	201-204 4	" " " " " "	"
" " " " " "	301-310 3	Cottage Hotel, C	5
Central Ave., S. of Spring to N. of Factory	1	County Court House and Jail, C	5
" " " " " "	15-39 5	" " " " " "	"
" " " " " "	40-63 7	Electric Light Station, E	3
" " " " " "	101-142 4	" " " " " "	"
" " " " " "	601-614 6	" " " " " "	"
Cherry, " " " " " "	701-704 7	" " " " " "	"
" " " " " "	1	" " " " " "	"
Dale, D	101-118 2	" " " " " "	"
Detroit, " " " " " "	119-124 3	Fire Department, Hose House, F	5
" " " " " "	125-136 2	Fitzgibbons & Co., Oar Mfg., F	4
" " " " " "	149-160 5	" " " " " "	"
" " " " " "	161-179 2	" " " " " "	"
Factory, F	101-118 2	" " " " " "	"
" " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"
Grant, G	101-118 2	" " " " " "	"
Gum, " " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"
Hawpach, H	101-118 2	" " " " " "	"
High, " " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"
Lafayette, L	101-118 2	" " " " " "	"
" " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"
Lake, " " " " " "	101-118 2	" " " " " "	"
" " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"
Maple, M	101-118 2	" " " " " "	"
Michigan, " " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"
" " " " " "	101-118 2	" " " " " "	"
" " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"
" " " " " "	101-118 2	" " " " " "	"
" " " " " "	119-124 3	" " " " " "	"
" " " " " "	125-136 2	" " " " " "	"
" " " " " "	137-158 3	" " " " " "	"

NOTE.—House Numbers given are arbitrary.

KEY

1 FIRE WALL GIN. A.V. ROOF.
2 FIRE WALL GIN. A.V. ROOF.
3 FIRE WALL GIN. A.V. ROOF.
4 FIRE WALL GIN. A.V. ROOF.
5 FIRE WALL GIN. A.V. ROOF.
6 FIRE WALL GIN. A.V. ROOF.
7 FIRE WALL GIN. A.V. ROOF.
8 FIRE WALL GIN. A.V. ROOF.
9 FIRE WALL GIN. A.V. ROOF.
10 FIRE WALL GIN. A.V. ROOF.
11 FIRE WALL GIN. A.V. ROOF.
12 FIRE WALL GIN. A.V. ROOF.
13 FIRE WALL GIN. A.V. ROOF.
14 FIRE WALL GIN. A.V. ROOF.
15 FIRE WALL GIN. A.V. ROOF.
16 FIRE WALL GIN. A.V. ROOF.
17 FIRE WALL GIN. A.V. ROOF.
18 FIRE WALL GIN. A.V. ROOF.
19 FIRE WALL GIN. A.V. ROOF.
20 FIRE WALL GIN. A.V. ROOF.
21 FIRE WALL GIN. A.V. ROOF.
22 FIRE WALL GIN. A.V. ROOF.
23 FIRE WALL GIN. A.V. ROOF.
24 FIRE WALL GIN. A.V. ROOF.
25 FIRE WALL GIN. A.V. ROOF.
26 FIRE WALL GIN. A.V. ROOF.
27 FIRE WALL GIN. A.V. ROOF.
28 FIRE WALL GIN. A.V. ROOF.
29 FIRE WALL GIN. A.V. ROOF.
30 FIRE WALL GIN. A.V. ROOF.
31 FIRE WALL GIN. A.V. ROOF.
32 FIRE WALL GIN. A.V. ROOF.
33 FIRE WALL GIN. A.V. ROOF.
34 FIRE WALL GIN. A.V. ROOF.
35 FIRE WALL GIN. A.V. ROOF.
36 FIRE WALL GIN. A.V. ROOF.
37 FIRE WALL GIN. A.V. ROOF.
38 FIRE WALL GIN. A.V. ROOF.
39 FIRE WALL GIN. A.V. ROOF.
40 FIRE WALL GIN. A.V. ROOF.
41 FIRE WALL GIN. A.V. ROOF.
42 FIRE WALL GIN. A.V. ROOF.
43 FIRE WALL GIN. A.V. ROOF.
44 FIRE WALL GIN. A.V. ROOF.
45 FIRE WALL GIN. A.V. ROOF.
46 FIRE WALL GIN. A.V. ROOF.
47 FIRE WALL GIN. A.V. ROOF.
48 FIRE WALL GIN. A.V. ROOF.
49 FIRE WALL GIN. A.V. ROOF.
50 FIRE WALL GIN. A.V. ROOF.
51 FIRE WALL GIN. A.V. ROOF.
52 FIRE WALL GIN. A.V. ROOF.
53 FIRE WALL GIN. A.V. ROOF.
54 FIRE WALL GIN. A.V. ROOF.
55 FIRE WALL GIN. A.V. ROOF.
56 FIRE WALL GIN. A.V. ROOF.
57 FIRE WALL GIN. A.V. ROOF.
58 FIRE WALL GIN. A.V. ROOF.
59 FIRE WALL GIN. A.V. ROOF.
60 FIRE WALL GIN. A.V. ROOF.
61 FIRE WALL GIN. A.V. ROOF.
62 FIRE WALL GIN. A.V. ROOF.
63 FIRE WALL GIN. A.V. ROOF.
64 FIRE WALL GIN. A.V. ROOF.
65 FIRE WALL GIN. A.V. ROOF.
66 FIRE WALL GIN. A.V. ROOF.
67 FIRE WALL GIN. A.V. ROOF.
68 FIRE WALL GIN. A.V. ROOF.
69 FIRE WALL GIN. A.V. ROOF.
70 FIRE WALL GIN. A.V. ROOF.
71 FIRE WALL GIN. A.V. ROOF.
72 FIRE WALL GIN. A.V. ROOF.
73 FIRE WALL GIN. A.V. ROOF.
74 FIRE WALL GIN. A.V. ROOF.
75 FIRE WALL GIN. A.V. ROOF.
76 FIRE WALL GIN. A.V. ROOF.
77 FIRE WALL GIN. A.V. ROOF.
78 FIRE WALL GIN. A.V. ROOF.
79 FIRE WALL GIN. A.V. ROOF.
80 FIRE WALL GIN. A.V. ROOF.
81 FIRE WALL GIN. A.V. ROOF.
82 FIRE WALL GIN. A.V. ROOF.
83 FIRE WALL GIN. A.V. ROOF.
84 FIRE WALL GIN. A.V. ROOF.
85 FIRE WALL GIN. A.V. ROOF.
86 FIRE WALL GIN. A.V. ROOF.
87 FIRE WALL GIN. A.V. ROOF.
88 FIRE WALL GIN. A.V. ROOF.
89 FIRE WALL GIN. A.V. ROOF.
90 FIRE WALL GIN. A.V. ROOF.
91 FIRE WALL GIN. A.V. ROOF.
92 FIRE WALL GIN. A.V. ROOF.
93 FIRE WALL GIN. A.V. ROOF.
94 FIRE WALL GIN. A.V. ROOF.
95 FIRE WALL GIN. A.V. ROOF.
96 FIRE WALL GIN. A.V. ROOF.
97 FIRE WALL GIN. A.V. ROOF.
98 FIRE WALL GIN. A.V. ROOF.
99 FIRE WALL GIN. A.V. ROOF.
100 FIRE WALL GIN. A.V. ROOF.

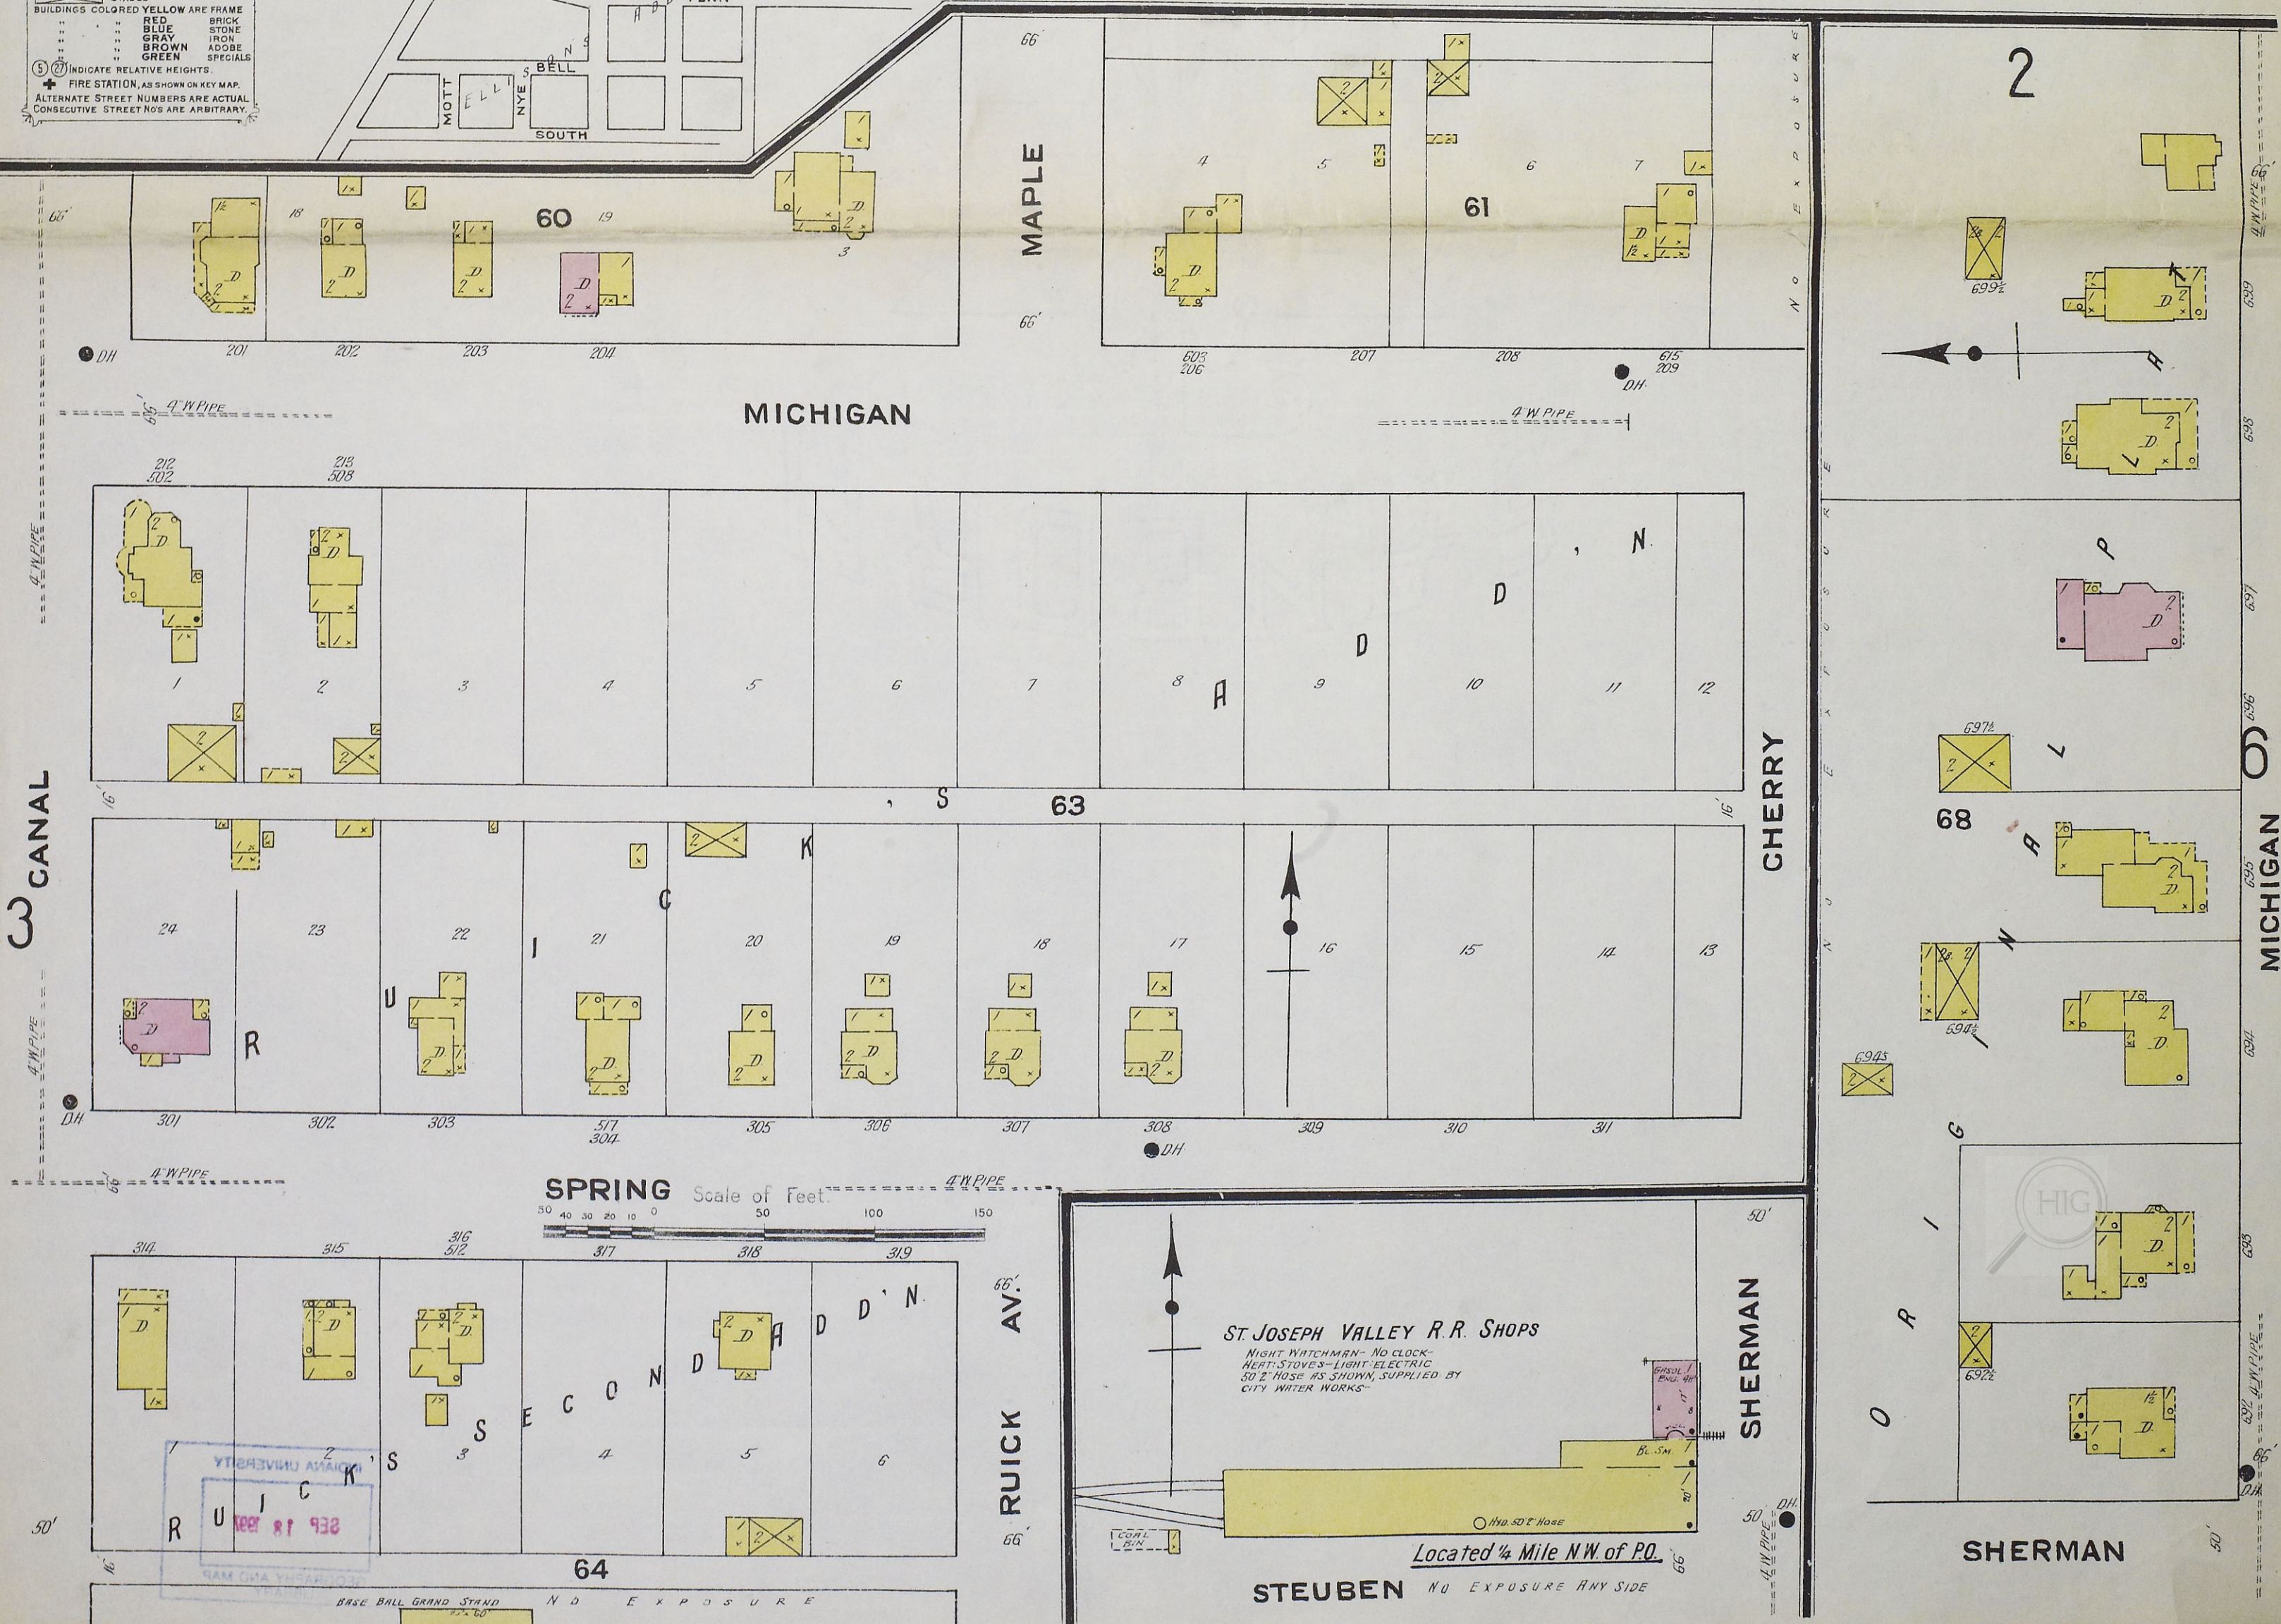

ST. JOSEPH VALLEY R.R. SHOPS

NIGHT WATCHMAN—NO CLOCK—
HEAT—STOVES—LIGHT—ELECTRIC
50' T. HOSE AS SHOWN, SUPPLIED BY
CITY WATER WORKS

Located 1/4 Mile N.W. of P.O.

NO EXPOSURE ANY SIDE