


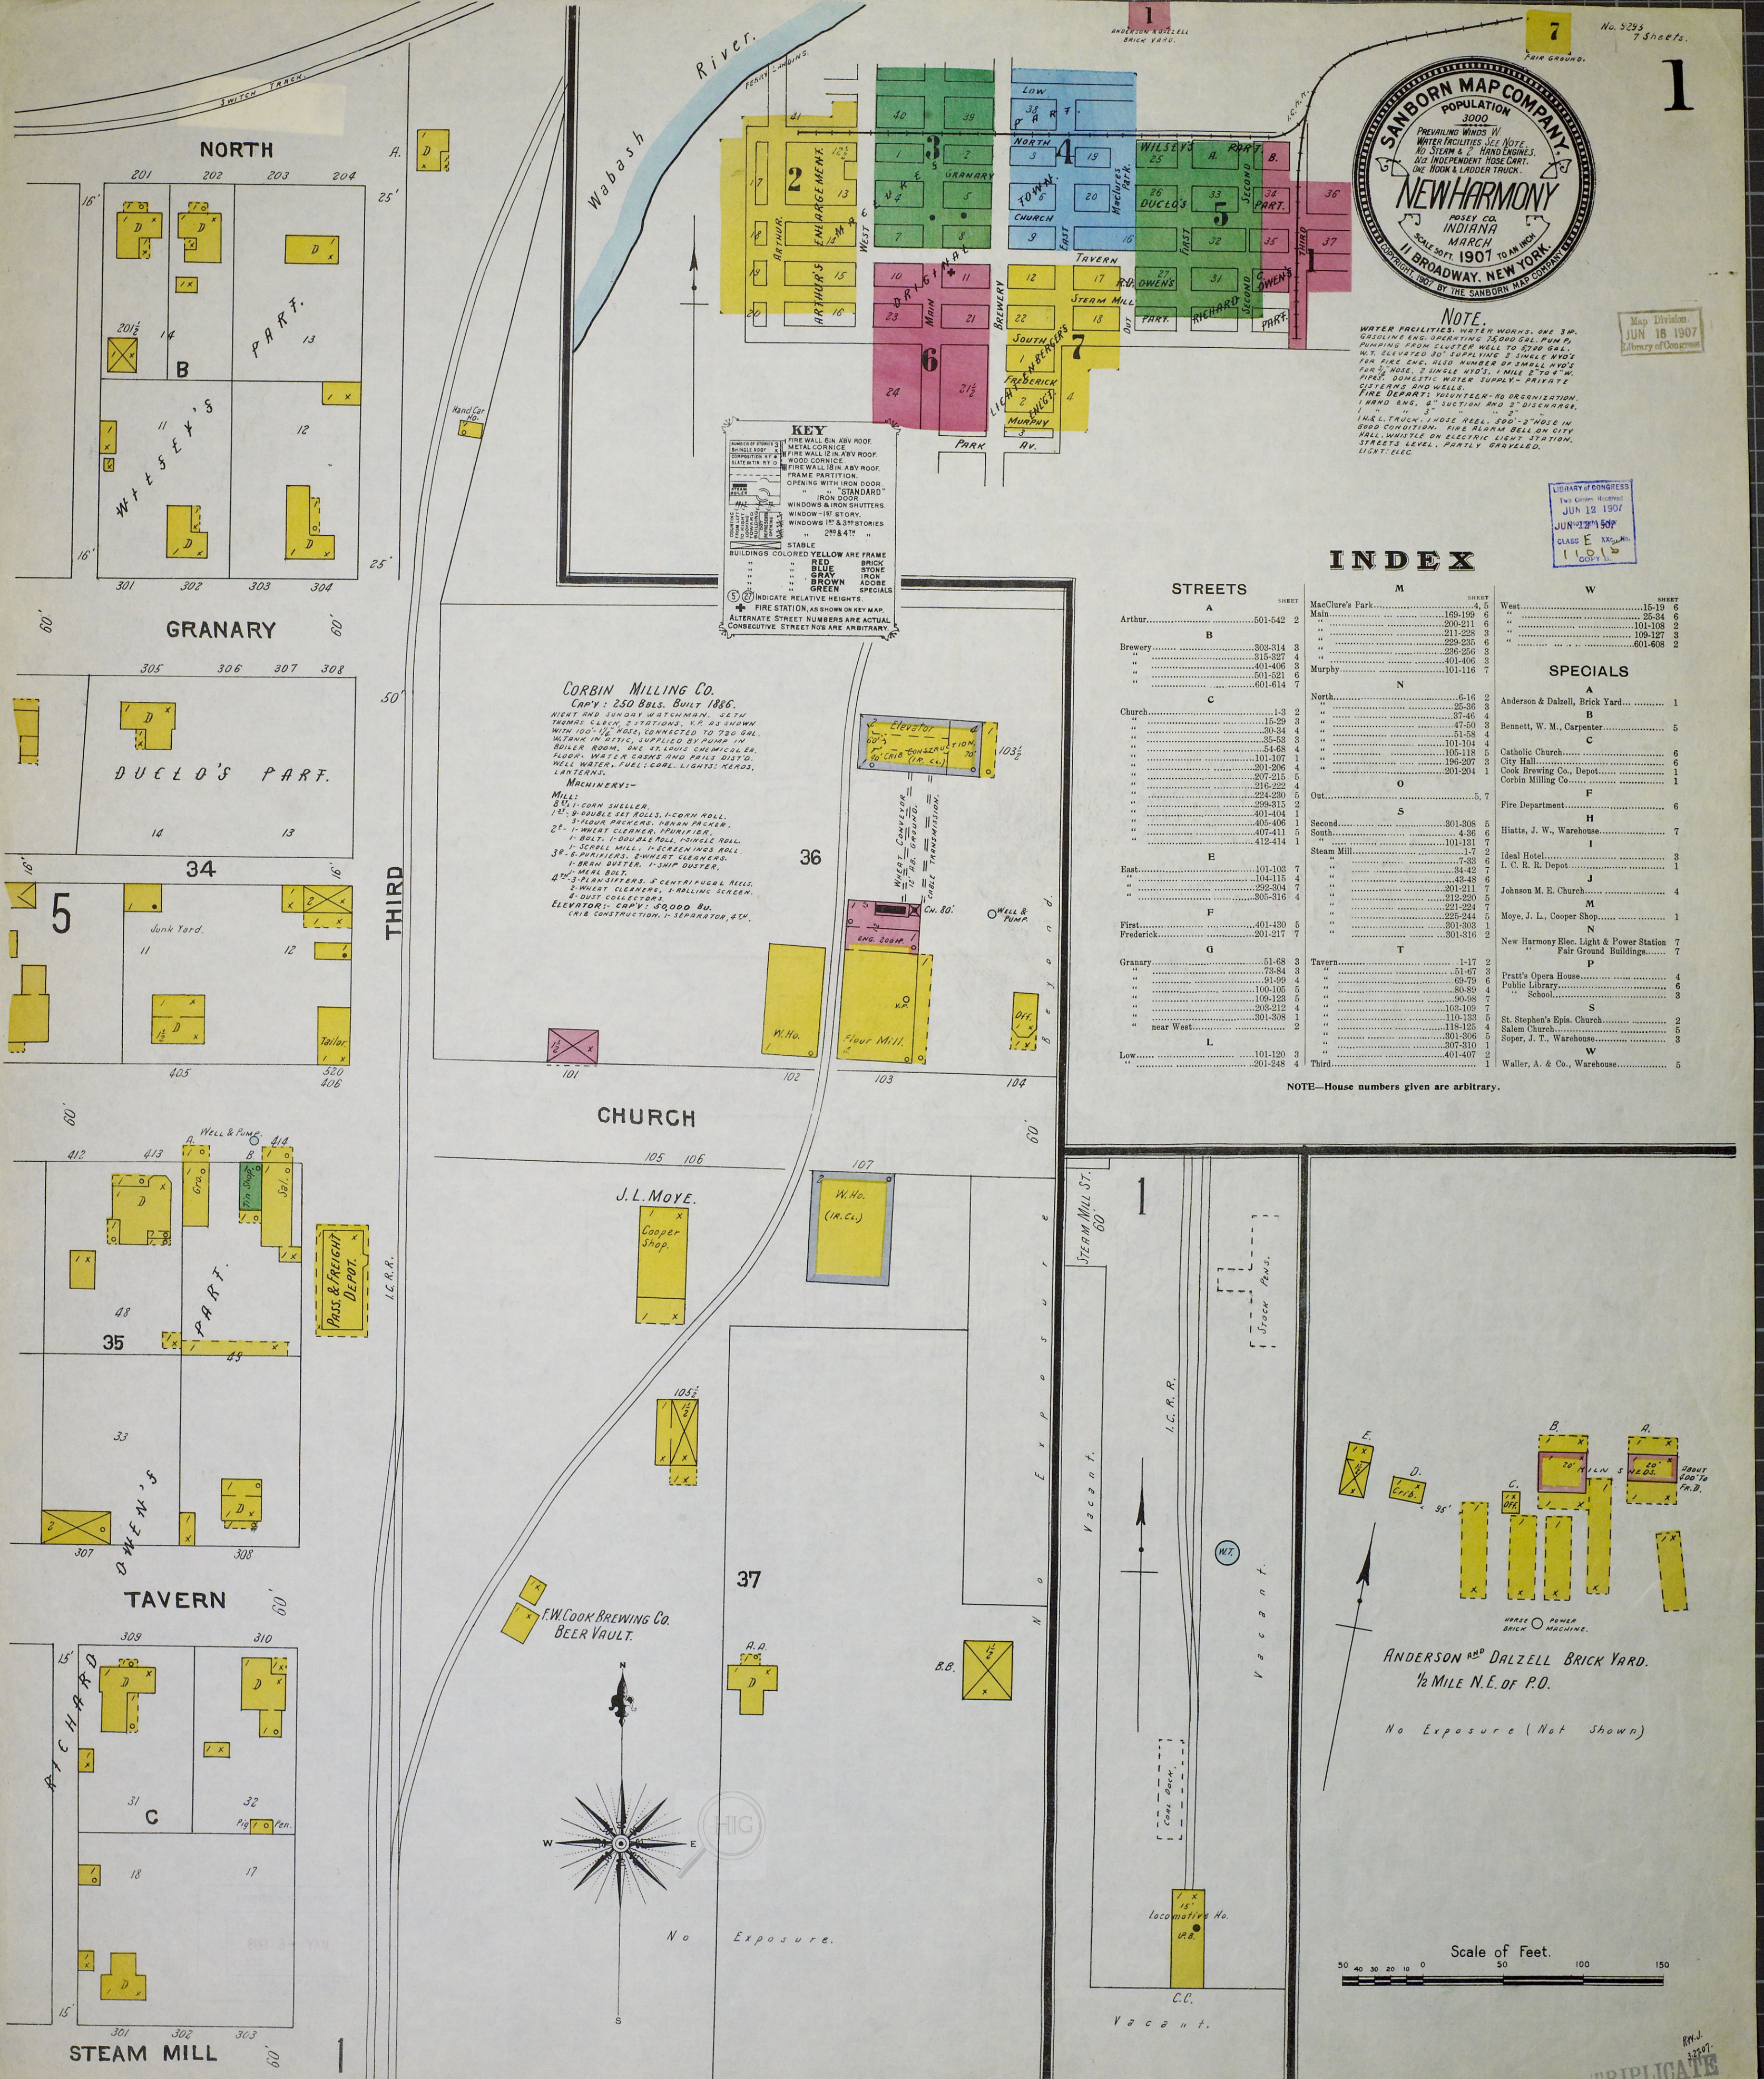

NOTE:
WATER FACILITIES: WATER WORKS, ONE 3P. GASOLINE ENG. OPERATING 15,000 GAL. PUM. P. PUMPING FROM CLUSTER WELL TO 6700 GAL. W.T. ELEVATED 30' SUPPLYING 2 SINGLE HYD'S FOR FIRE ENG. ALSO NUMBER OF SMALL HYD'S FOR 1/2 HOSE, 2 SINGLE HYD'S, 1 MILE 5' TO 4" PIPES, DOMESTIC WATER SUPPLY, PRIVATE CISTERNS AND WELLS.
FIRE DEPT.: 10' LADDER, NO ORGANIZATION.
1 HAND ENG. 4" SUCTION AND 2 DISCHARGE.
1 MILE TRUCK, 1 HOSE REEL, 500' 3" HOSE IN GOOD CONDITION. FIRE ALARM BELL ON CITY HALL, WHISTLE ON ELECTRIC LIGHT STATION.
STREETS LEVEL, PARTLY GRAVELED.
LIGHT: ELEC.


Map Division
JUN 18 1907
Library of Congress

LIBRARY OF CONGRESS
JUN 18 1907
CLASS E
COPY 1

INDEX

STREETS		SHEET	
A	MacClure's Park	4, 5	West
Arthur	Main	159-199	6
B	"	200-211	6
Brewery	"	211-228	8
"	"	228-235	6
"	"	235-256	8
"	"	401-406	3
"	Murphy	101-116	7
C	Church	1-13	2
"	"	15-29	3
"	"	30-34	4
"	"	35-53	3
"	"	54-68	4
"	"	101-107	1
"	"	201-206	4
"	"	207-215	6
"	"	216-222	4
"	"	224-230	5
"	"	230-315	2
"	"	401-404	1
"	"	405-406	1
"	"	407-411	5
"	"	412-414	1
E	East	101-103	7
"	"	104-115	4
"	"	229-304	7
"	"	305-316	4
F	First	401-430	5
Frederick	"	201-217	7
G	Granary	51-68	3
"	"	73-84	3
"	"	91-99	4
"	"	100-105	5
"	"	106-123	5
"	"	203-212	4
"	"	301-308	1
"	near West	2	
L	Low	101-120	3
"	"	201-248	4
M	MacClure's Park	4, 5	
N	North	6-16	2
"	"	25-36	3
"	"	37-46	3
"	"	47-50	3
"	"	51-58	4
"	"	101-104	4
"	"	105-118	5
"	"	211-228	8
"	"	196-207	3
"	"	201-204	1
O	Out	5, 7	
S	Second	301-308	5
South	"	4-36	6
"	"	101-131	7
Steam Mill	"	1-7	2
"	"	7-33	6
"	"	34-42	7
"	"	43-48	6
"	"	201-211	7
"	"	212-220	5
"	"	221-224	7
"	"	225-244	5
"	"	301-303	1
"	"	301-316	2
T	Tavern	1-17	2
"	"	51-67	3
"	"	69-79	6
"	"	80-89	4
"	"	90-98	7
"	"	103-109	7
"	"	110-133	5
"	"	118-125	4
"	"	301-306	5
"	"	307-310	1
"	"	401-407	2
W	Waller, A. & Co., Warehouse	5	

NOTE—House numbers given are arbitrary.

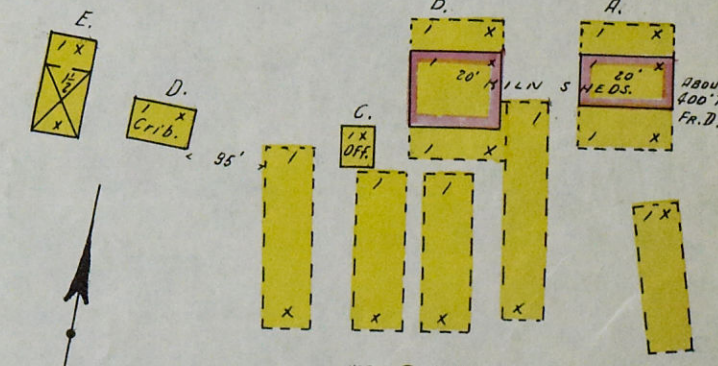

ANDERSON AND DALZELL BRICK YARD.
1/2 MILE N.E. OF P.D.

No Exposure (Not Shown)

Scale of Feet.
50 40 30 20 10 0 50 100 150

TRIPPLICATE